






Daily Balancing Costs

Date:

14/01/2018

BSUoS Charge Estimate: £2.06/MWh
Total Outturn: £2.84m

BM Cost (Indicative)
AS Cost (Estimate)

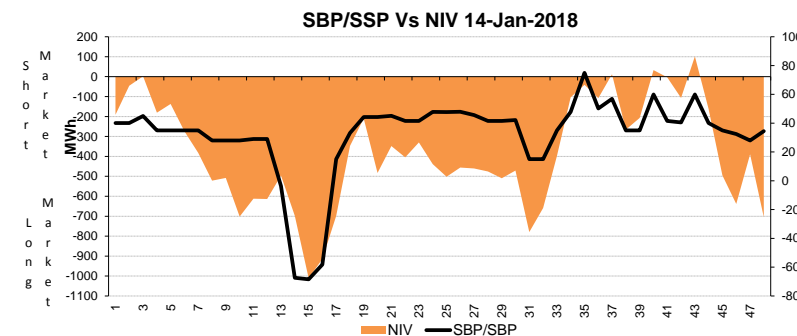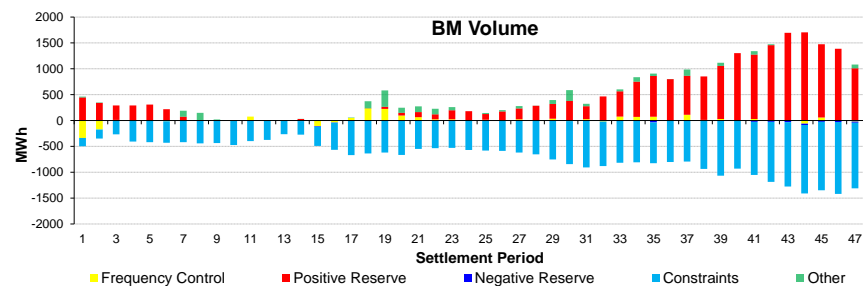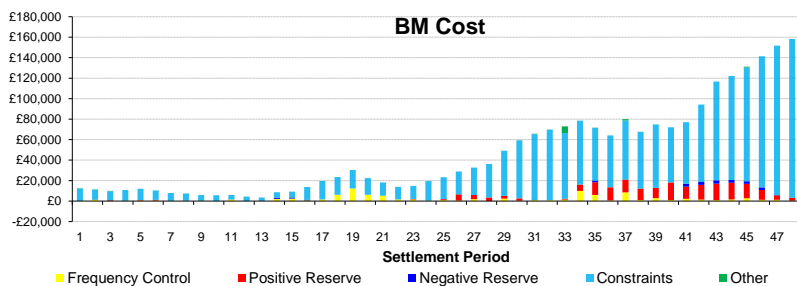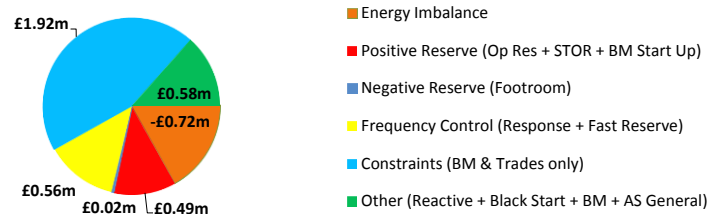

Commentary

Demand errors of up to -1800MW seen in the early morning. 800MW of STOR was run over DP following plant losses. Some voltage plant was run overnight in Wales and in the Midlands. Overnight trades for ROCOF were taken on the interconnectors. A constraint was active in the North of England Scotland borders hence many wind farms were bid off.