
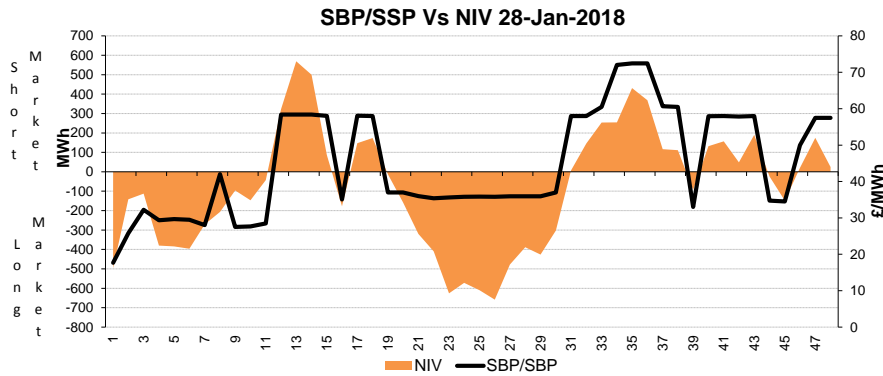
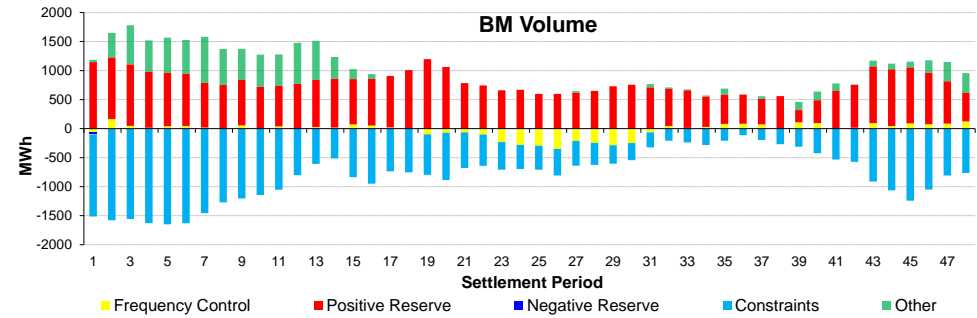
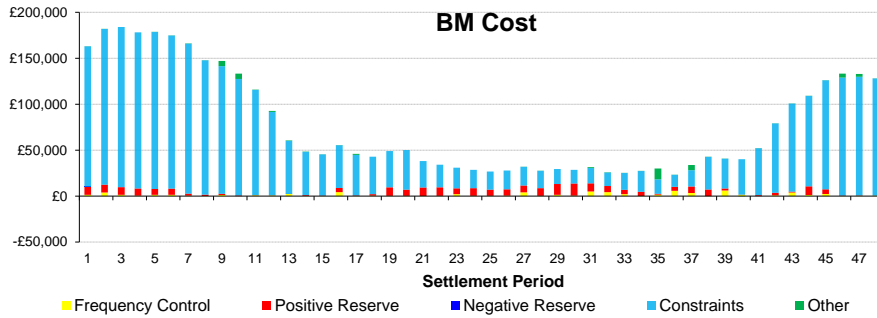
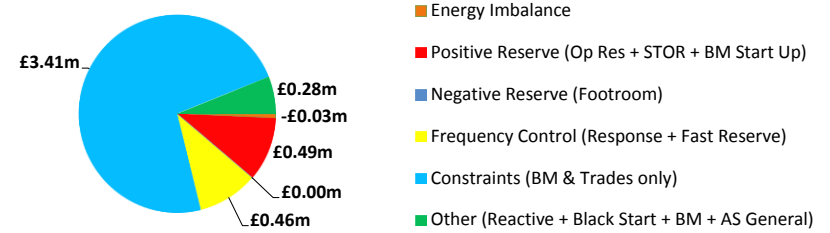


Daily Balancing Costs

BSUoS Charge Estimate: £3.49/MWh
Total Outturn: £4.61m

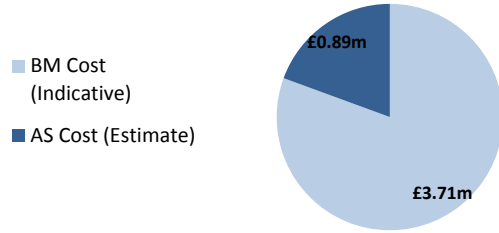

Commentary

Four machines were held for regulating reserve over the day. Trades and BM actions were taken for constraints over the Scotland England border. Trades were taken on the interconnectors for ROCOF overnight. Voltage plant was used in Wales the Midlands and East Anglia.