






Daily Balancing Costs

BSUoS Charge Estimate: £0.84/MWh
Total Outturn: £1.08m

BM Cost (Indicative)
AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR + BM Start Up)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM + AS General)

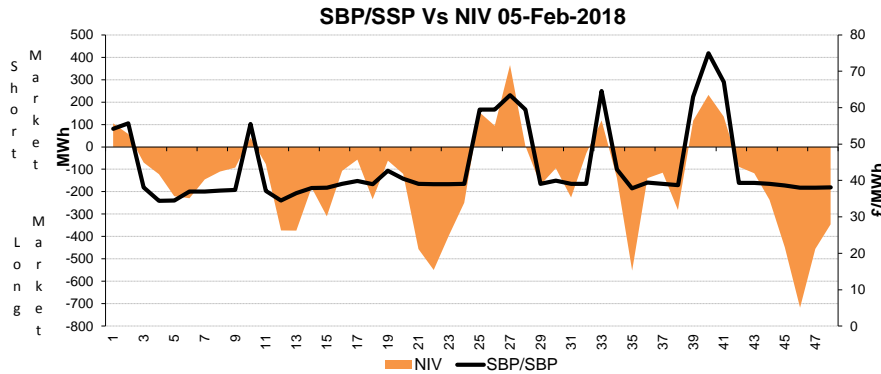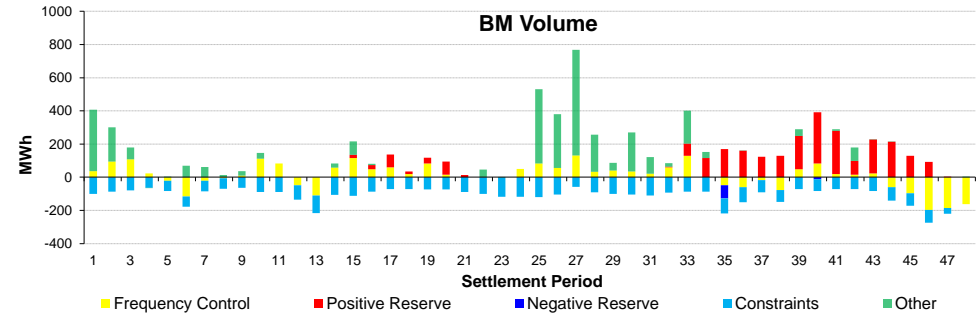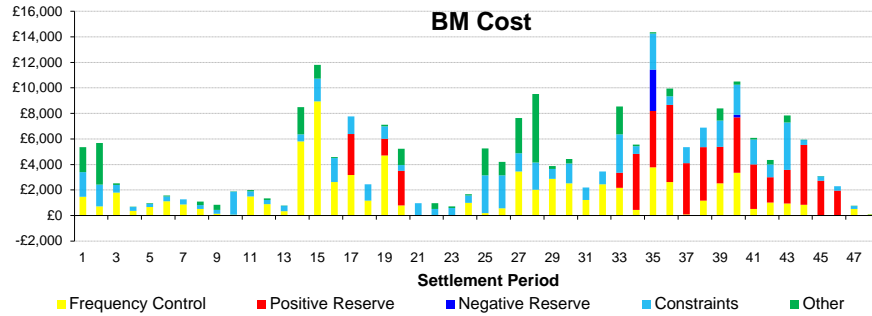

Commentary

234MW of STOR was run in the morning
No trades were required for constraints or ROCOF. With low wind generation all required voltage plant was met by the market. BM actions were taken throughout the day for constraint in South Wales due to circuit out of service and high levels of generation in the area.