
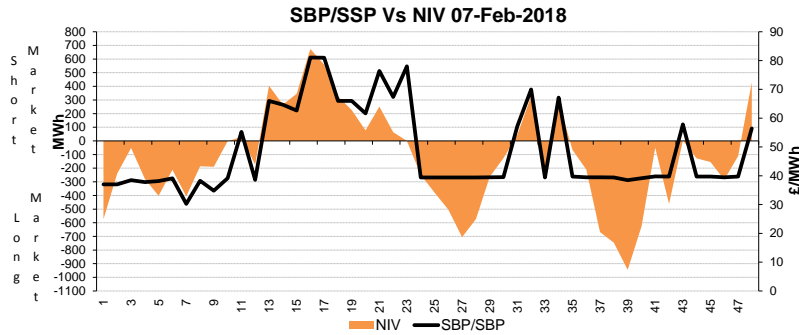
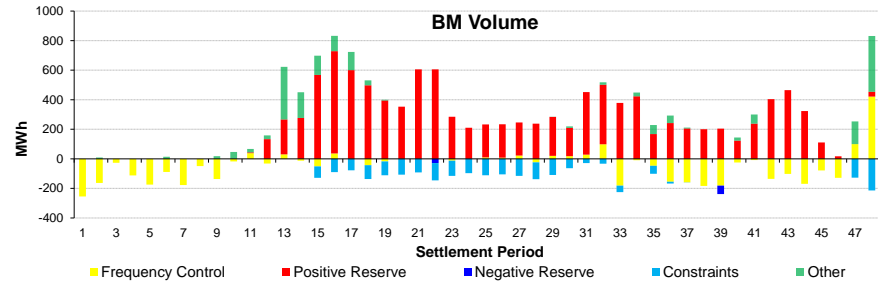
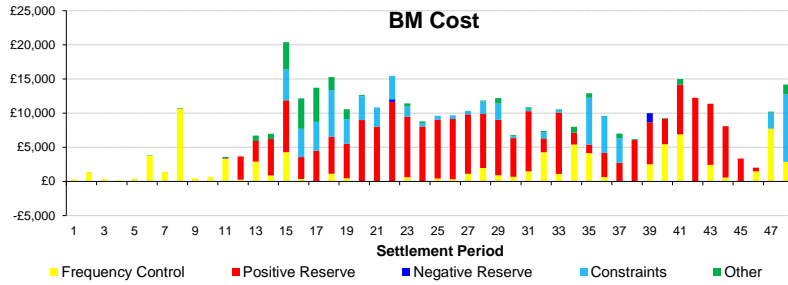
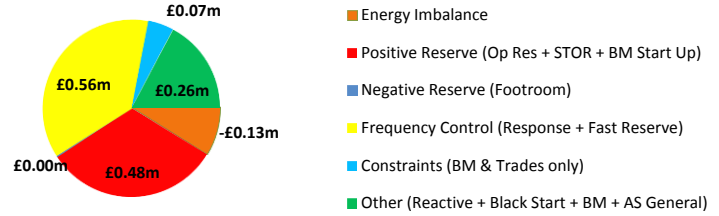


# Daily Balancing Costs

Date:

07/02/2018

BSUoS Charge Estimate: £0.93/MWh  
Total Outturn: £1.24m

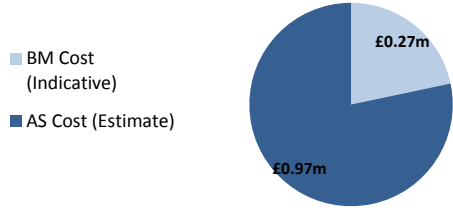

## Commentary

370MW of STOR was run in the morning pickup. Solar was underestimated by 1500MW in the morning. No trades were required for constraints or ROCOF. Some BM actions were taken in Scotland to reduce generation output due to a Constraint in Scotland. BM actions were taken in South Wales due to a circuit outage and high generation in the area.