
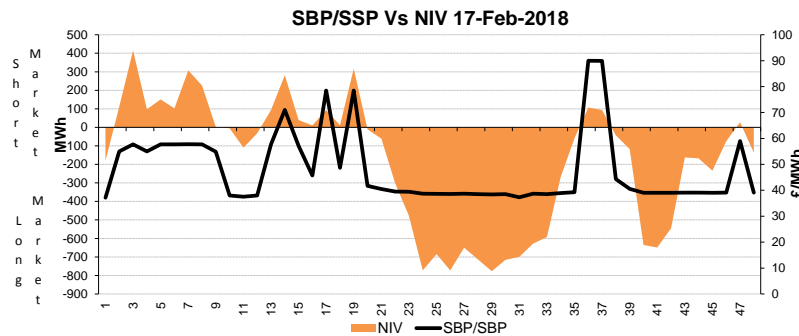
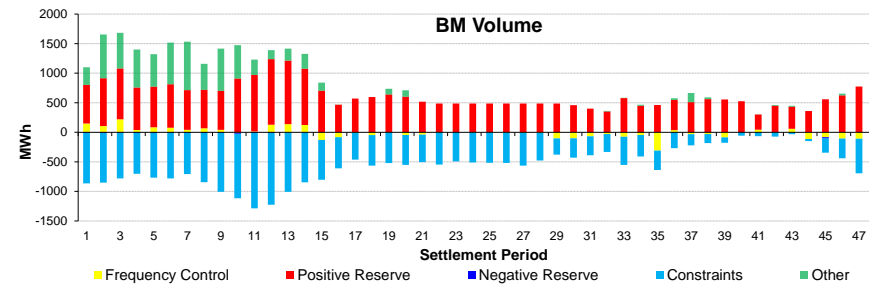
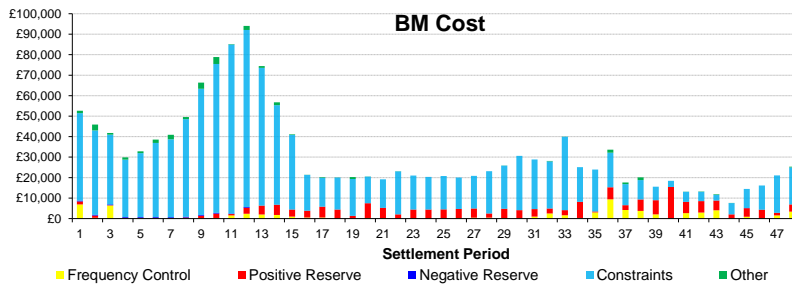
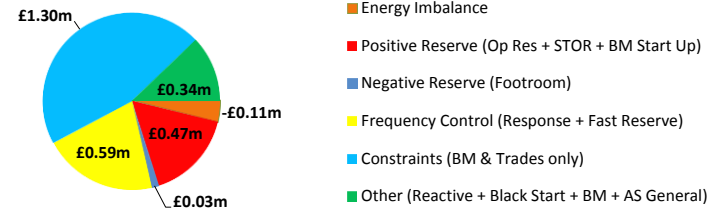


Daily Balancing Costs

BSUoS Charge Estimate: £1.84/MWh
Total Outturn: £2.62m

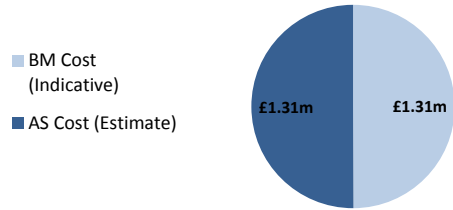

Commentary

415 MW of STOR was run for the morning pickup. Trades were taken on the interconnectors for ROCOF in the early morning. Trades were taken for congestion in the North of Scotland on one wind farm. BM actions were taken for voltage control in Wales overnight and bids were taken for congestion in Scotland.