
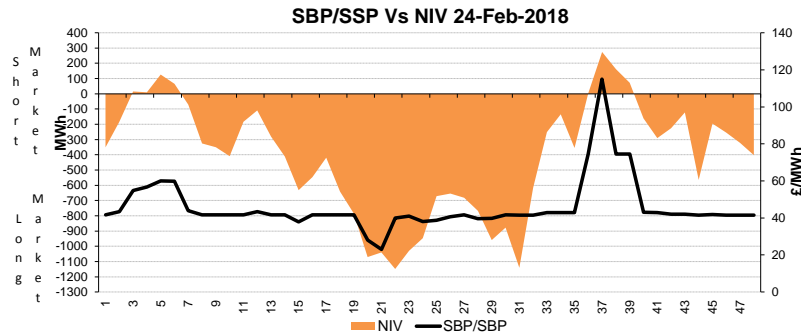
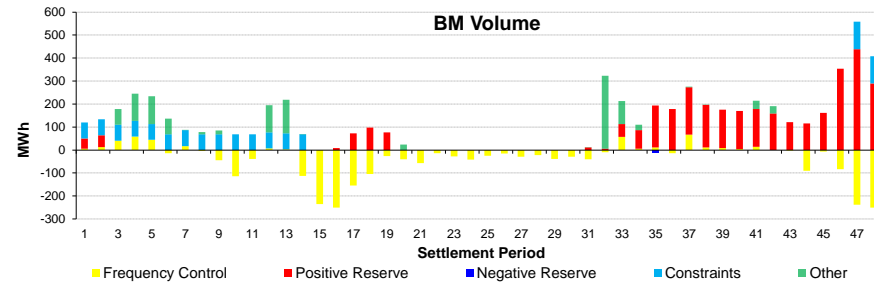
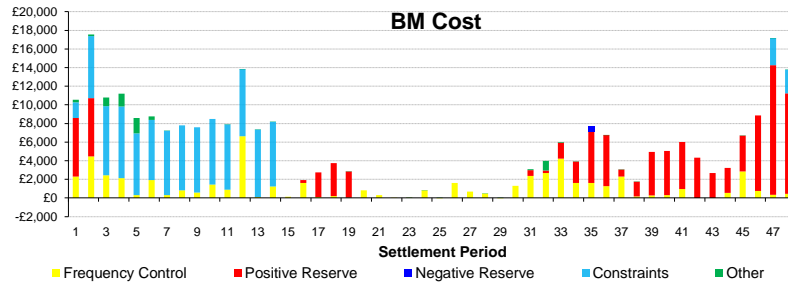
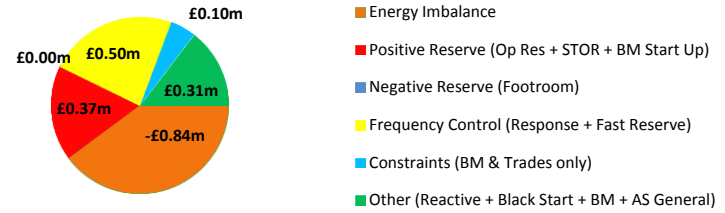


# Daily Balancing Costs

BSUoS Charge Estimate: £0.62/MWh  
 Total Outturn: £0.43m

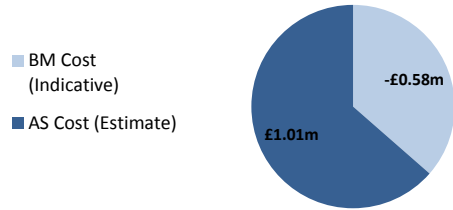

## Commentary

200 MW of STOR was run for the darkness peak of the day. Trades were taken on the interconnectors for ROCOF in the early morning. A small number of BM actions were taken in Wales for voltage control.