
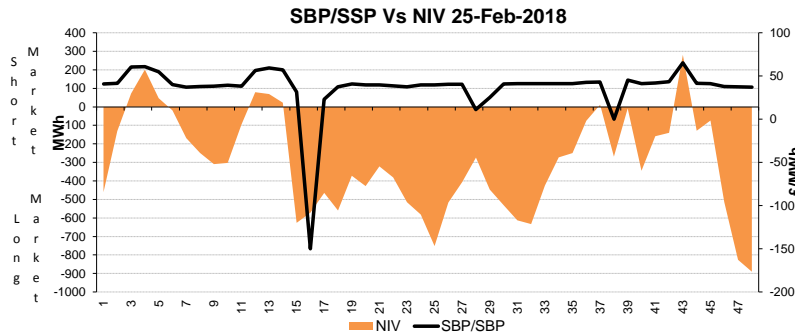
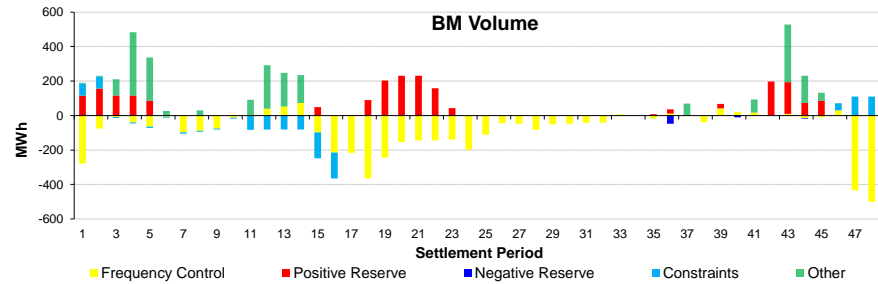
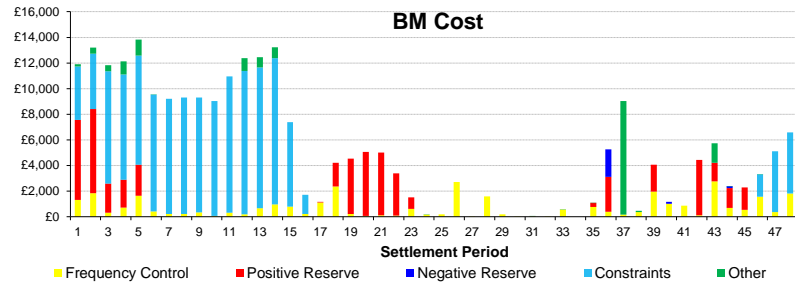
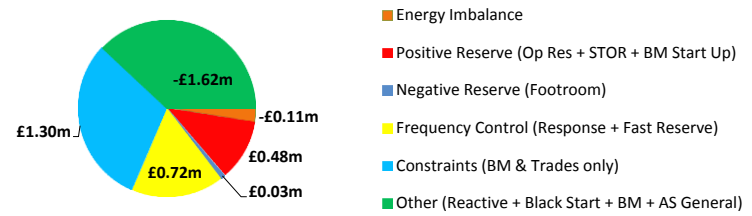


Daily Balancing Costs

Date:

25/02/2018

BSUoS Charge Estimate: £0.86/MWh
Total Outturn: £0.80m

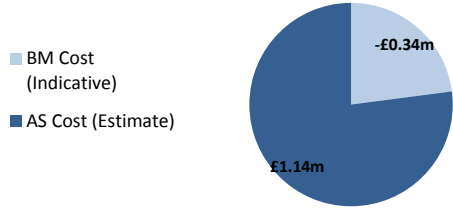

Commentary

Wind errors of 900 to 1300MW seen across period the early morning , up to 700MW of STOR run over the evening peak.
Trades were taken on the interconnectors for ROCOF overnight. A small amount of actions in the BM were taken to manage voltage control in Wales. A higher than forecast level of PV suppressed the demand up to 2.1GW lower than forecast across the day.