
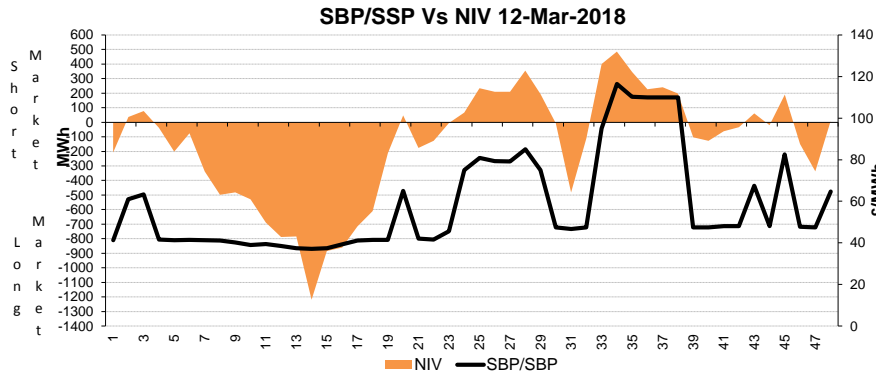
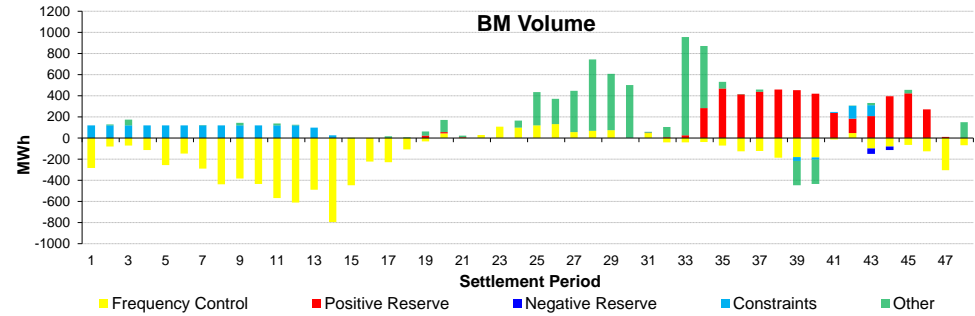
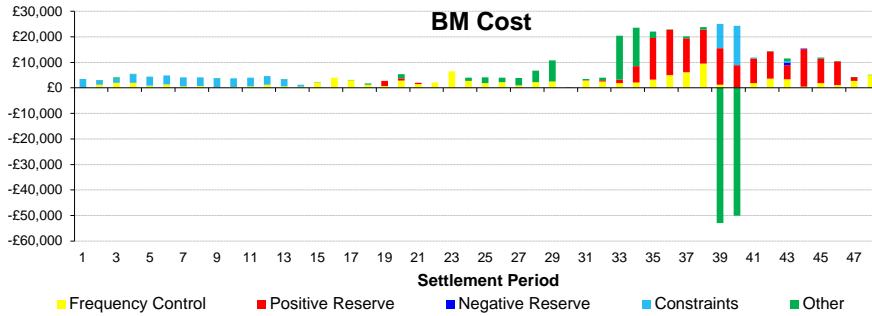
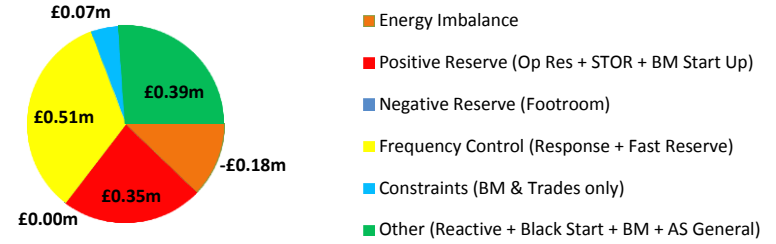


Daily Balancing Costs

BSUoS Charge Estimate: £0.94/MWh
Total Outturn: £1.14m

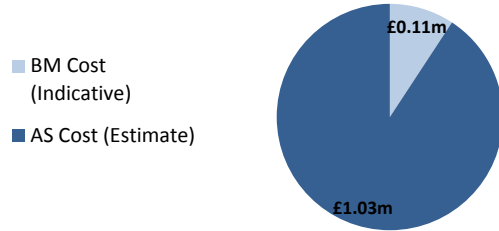

Commentary

200MW of STOR was run for the morning peak and for the evening peak. No trades were carried out for Rocof, constraints or voltage control. One machine was bought in the BM for voltage control in the early morning in the North of England. One machine in Scotland was run for local constraint just before midnight. One Machine was bid off in the North of England for a local constraint. SO-SO Trade was instigated by a third party for 500MW at ~£265 /MWh for settlement periods 39-40.