
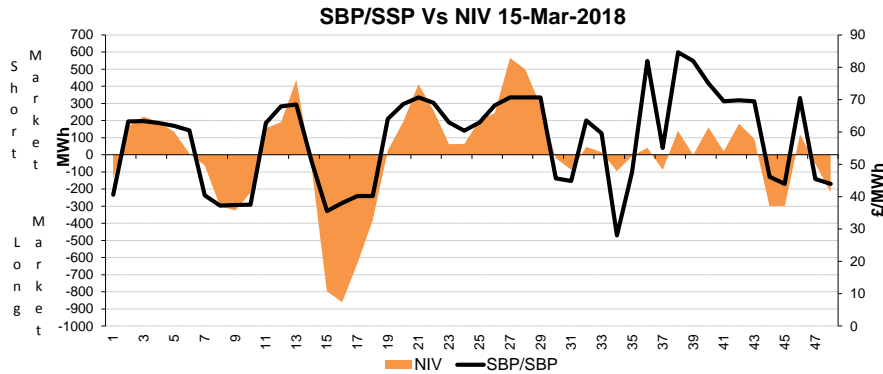
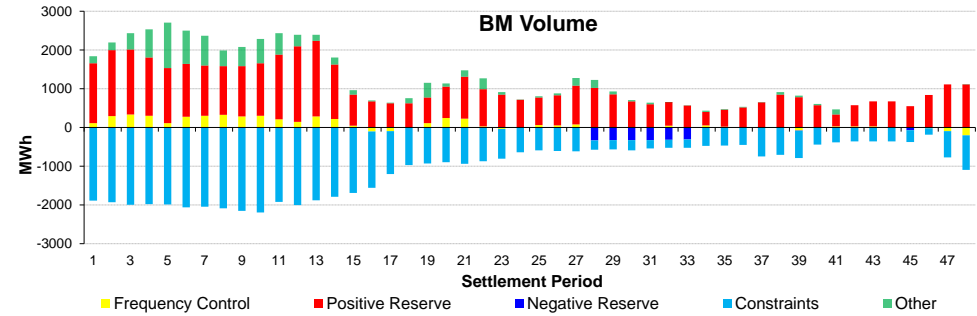
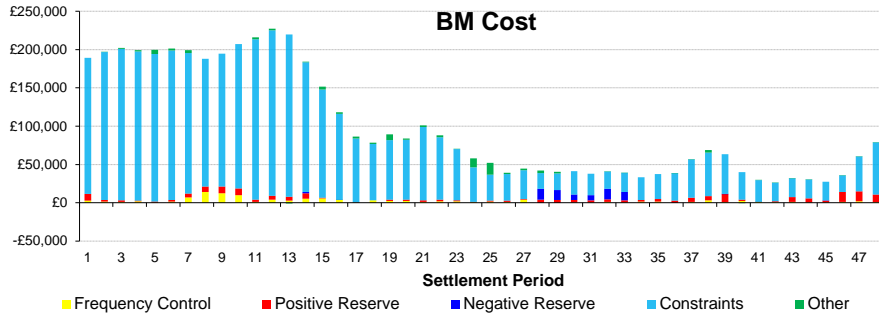
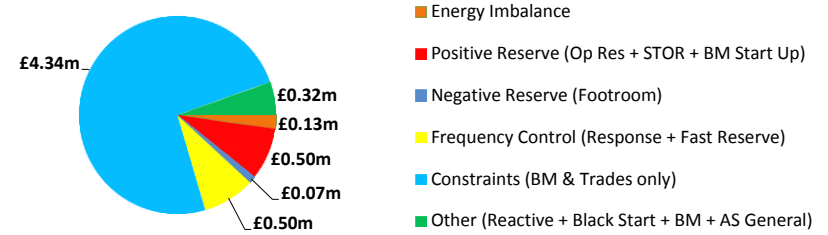


Daily Balancing Costs

BSUoS Charge Estimate: £3.77/MWh
 Total Outturn: £5.85m

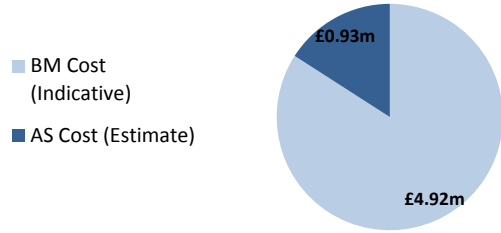

Commentary

150MW of STOR run for the morning peak. Wind generation levels were moderate to high; some units were traded off for local constraint in Scotland. Trades were carried out on the interconnectors for Rocof. A large number of units were Bid off in the BM to manage constraint in the North of England. 3 machines were bid off for a short period of time in Wales due to local constraint. Following a circuit trip in the North of England, actions were taken to re-secure: frequency response was increased and a 3 machines were bid down in the BM, 150MW of Short Term Operating Reserve was required to provide reserve margin