
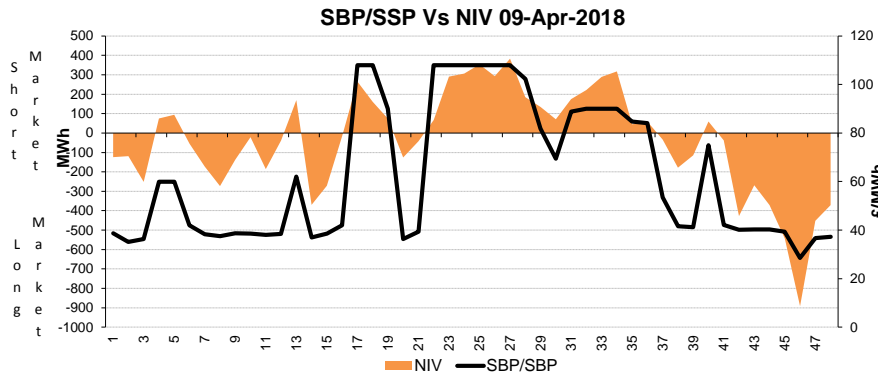
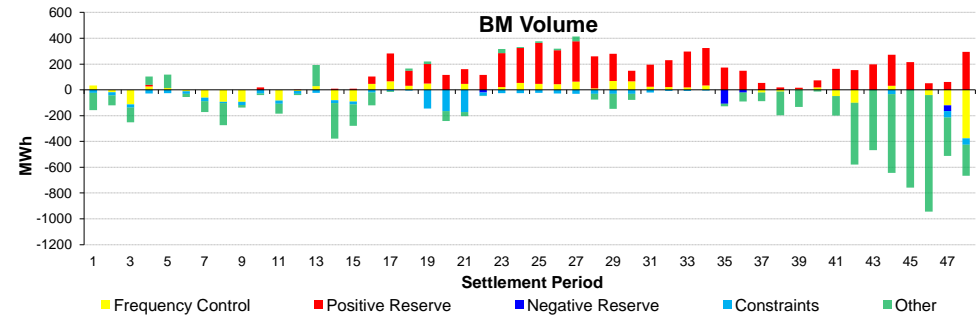
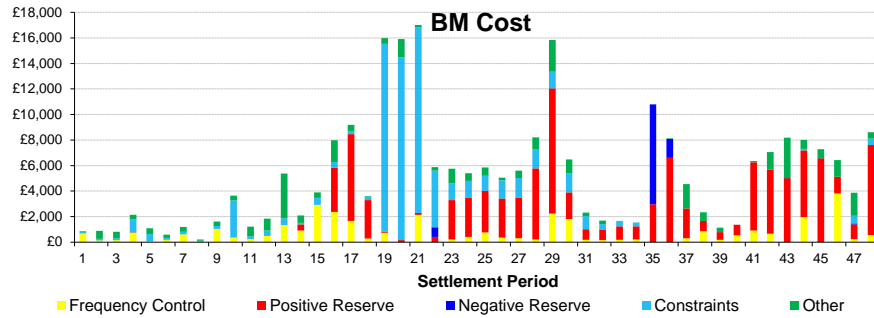
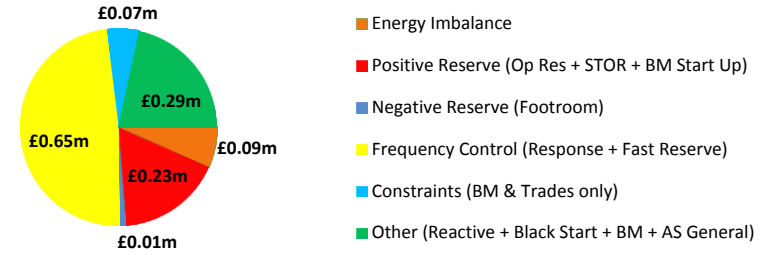


Daily Balancing Costs

BSUoS Charge Estimate: £1.13/MWh
 Total Outturn: £1.34m

BM Cost (Indicative)
 AS Cost (Estimate)



Commentary

384 MW of STOR was used in the morning pickup. Trades were taken on the interconnectors for Rocof. There were no machines bought for voltage overnight. This was managed by the market. However there were a couple of constraints in Wales by which four machines were bought off to help with this.