
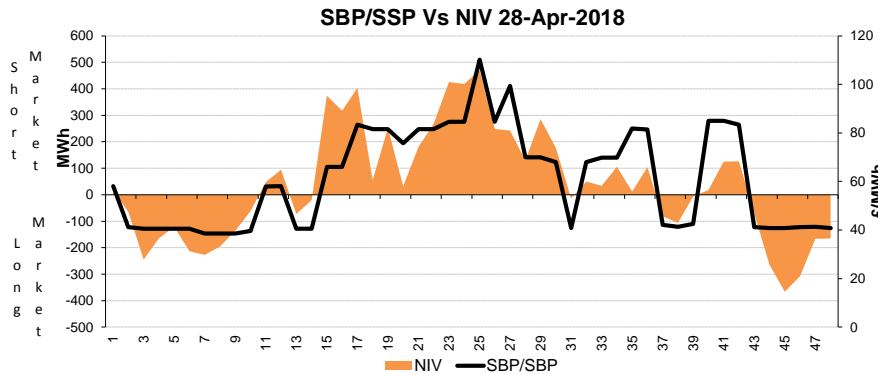
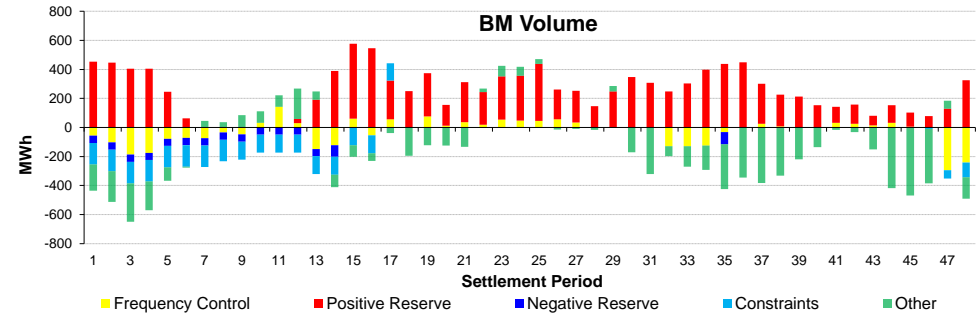
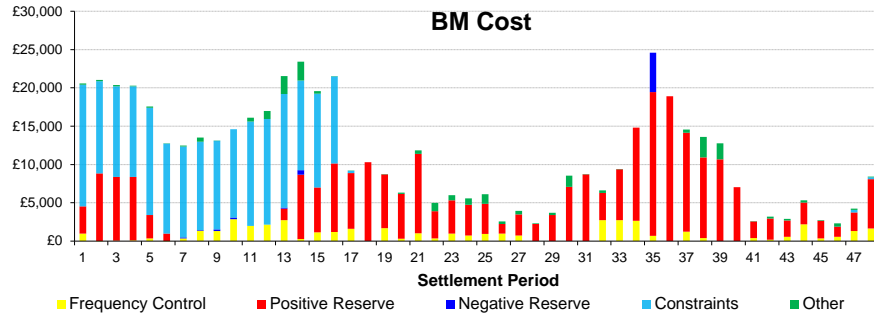
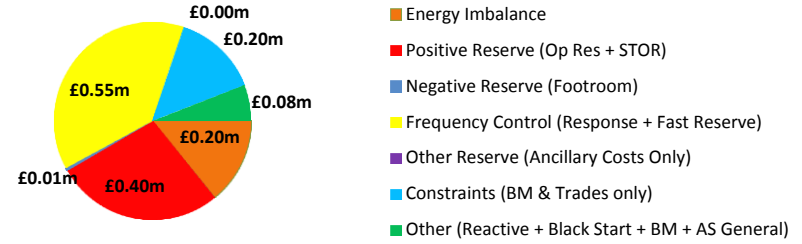


# Daily Balancing Costs

BSUoS Charge Estimate: £1.57/MWh  
Total Outturn: £1.63m

BM Cost (Indicative)  
AS Cost (Estimate)



## Commentary

The market was mixed throughout the day, Trades were taken on the Interconnectors for Response in the morning. Wind generation was low and overcast weather conditions resulted in low levels of Solar PV. Trades were carried out on the interconnectors and some BM Units for ROCOF in the morning. A machine was bought on in the North of England to manage voltage control in the early morning.

Note: A new category - Other Reserve - has been more clearly defined. Costs in this category used to be mapped to either Positive Reserve or Fast Reserve. These costs include BM Startup, Fast Start and some Hydro services. These changes have been made to align with the new Monthly Balancing Services Summary report.