
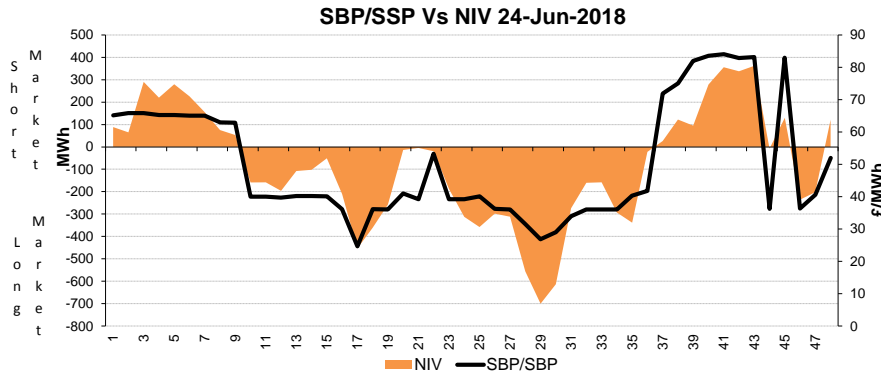
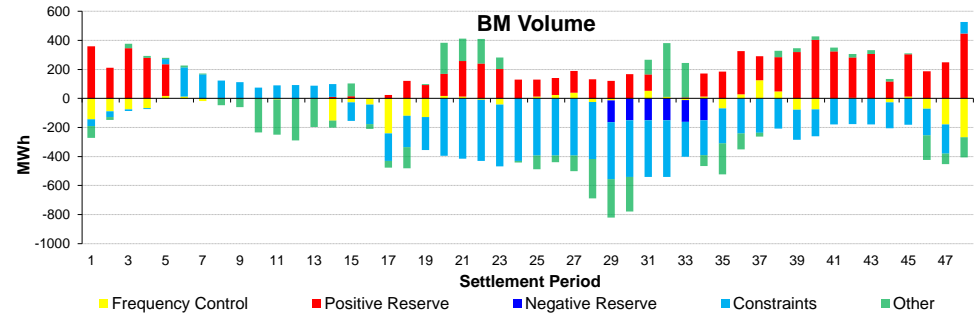
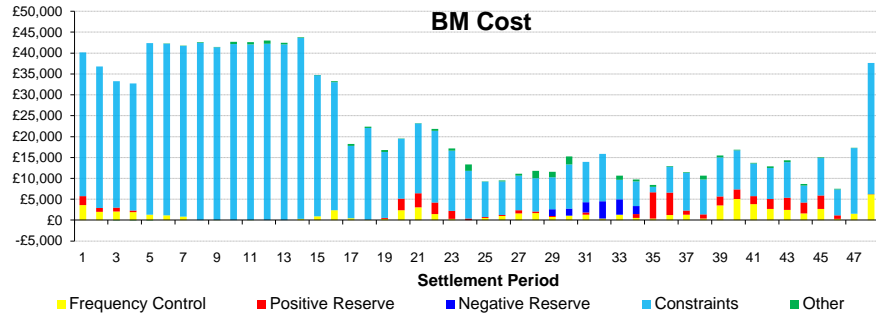
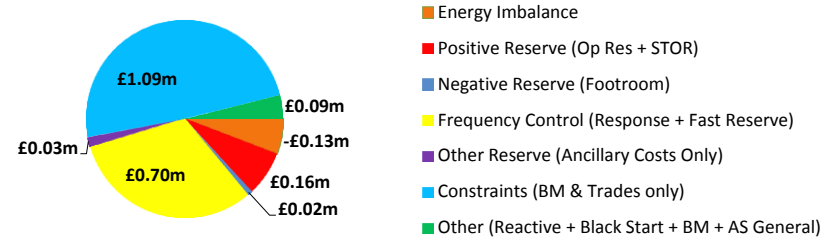


# Daily Balancing Costs

BSUoS Charge Estimate: £2.53/MWh  
 Total Outturn: £2.22m

BM Cost (Indicative)  
 AS Cost (Estimate)



## Commentary

Additional volume of high response was held in the early afternoon to cover for TV pick-ups for the England versus Panama World Cup match. Trades were carried out on the Interconnectors and BM units for ROCOF. Trades and BM actions were also required to manage Voltage Control in England. Trades were also carried out to manage local constraint in the North of Scotland.

Note: A new category - Other Reserve - has been more clearly defined. Costs in this category used to be mapped to either Positive Reserve or Fast Reserve. These costs include BM Startup, Fast Start and some Hydro services. These changes have been made to align with the new Monthly Balancing Services Summary report.