
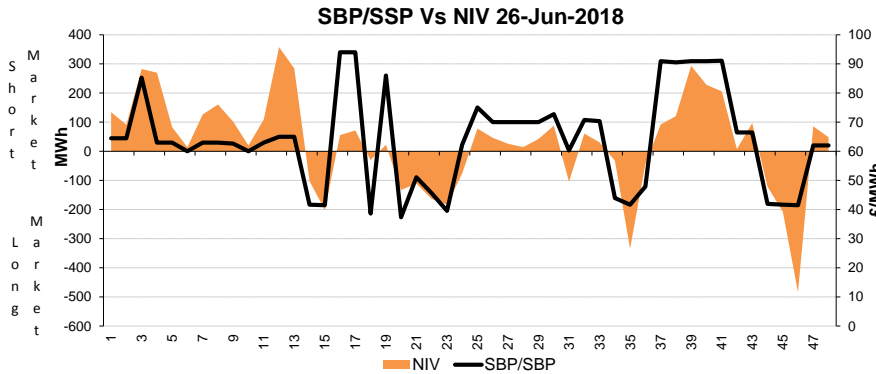
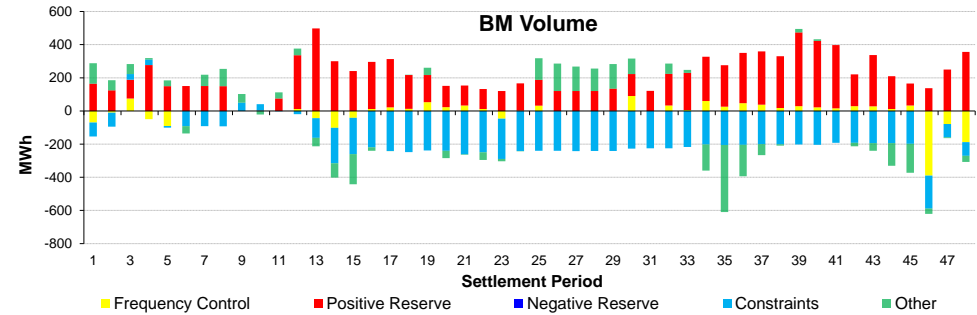
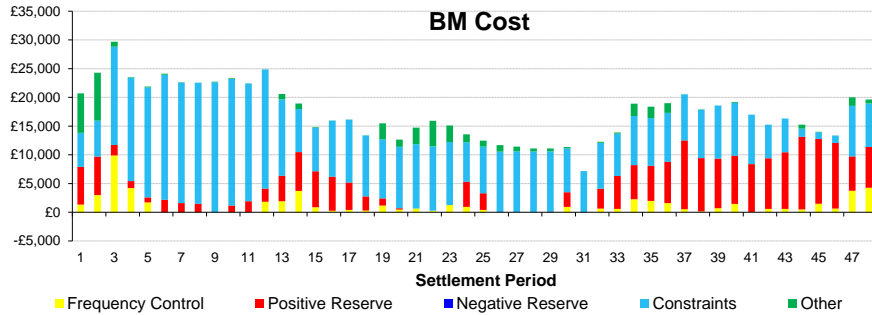
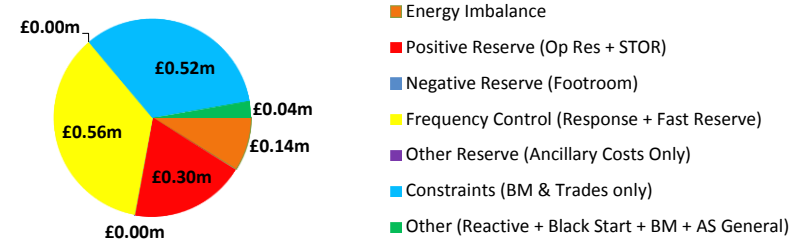


# Daily Balancing Costs

BSUoS Charge Estimate: £1.80/MWh  
 Total Outturn: £1.85m

BM Cost (Indicative)  
 AS Cost (Estimate)



## Commentary

As during the previous days, wind generation were very low whilst solar forecast peaked around 8.1GW. Over 450MW of STOR ran in the morning to accommodate the low wind generation. Voltage issues in Wales in the early morning were resolved with some trades and BM actions. Constraint issues in the same area were resolved with BM actions throughout the day.

Note: A new category - Other Reserve - has been more clearly defined. Costs in this category used to be mapped to either Positive Reserve or Fast Reserve. These costs include BM Startup, Fast Start and some Hydro services. These changes have been made to align with the new Monthly Balancing Services Summary report.