
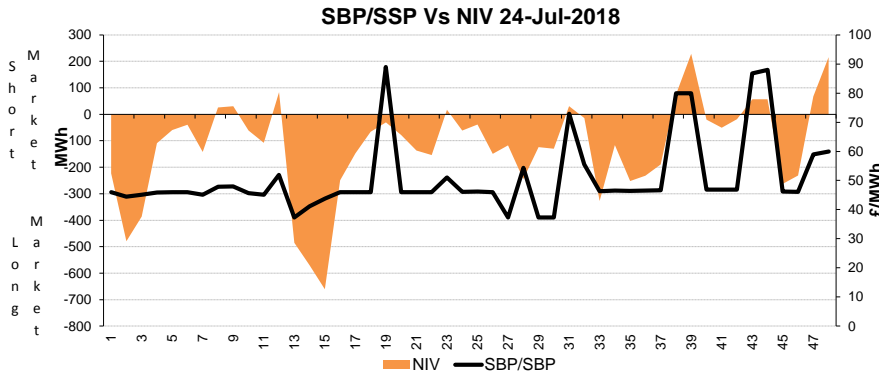
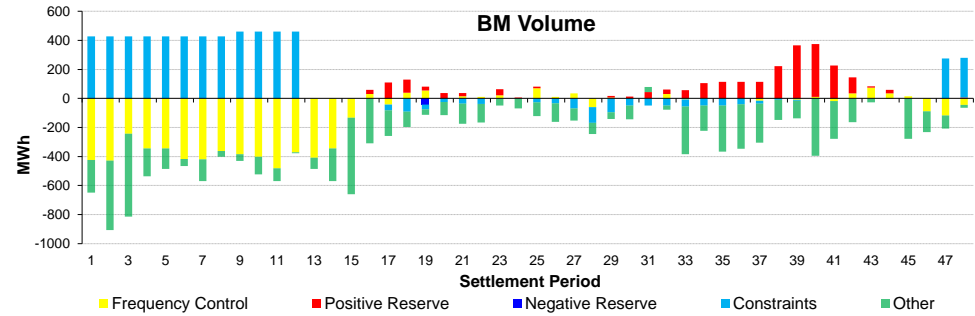
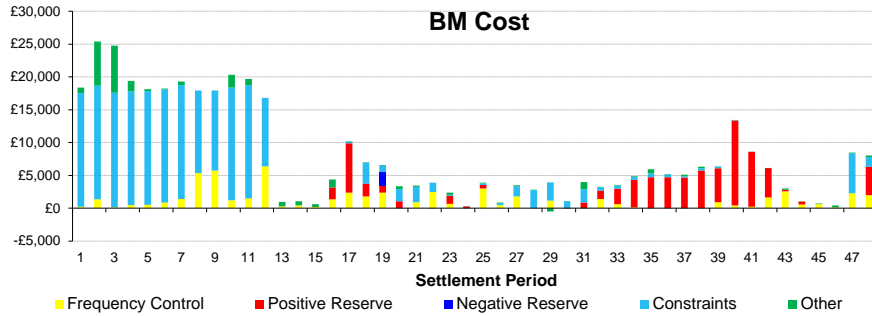
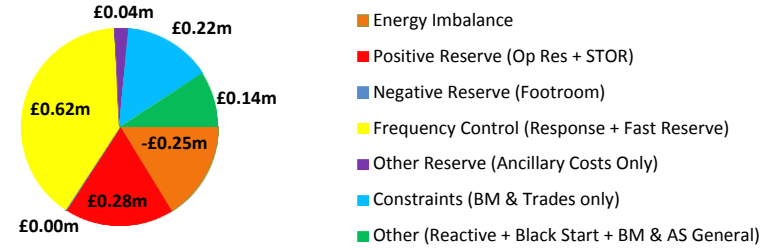


Daily Balancing Costs

BSUoS Charge Estimate: £1.33/MWh
Total Outturn: £1.25m

BM Cost (Indicative)
AS Cost (Estimate)



Commentary

Additional High response was held from 0800-0900hrs to cover for demand uncertainty. Trades were carried out on the Interconnectors and BM units for ROCOF. Trades were also required for Voltage control in the North of England. A small number of BM actions were required for constraints in Wales, the South West and the South East.

Note: A new category - Other Reserve - has been more clearly defined. Costs in this category used to be mapped to either Positive Reserve or Fast Reserve. These costs include BM Startup, Fast Start and some Hydro services. These changes have been made to align with the new Monthly Balancing Services Summary report.