





Date: 01/11/2018

BSUoS Charge Estimate: £1.41/MWh
Total Outturn: £1.89m


Daily Balancing Costs



■ BM Cost (Indicative)
■ AS Cost (Estimate)

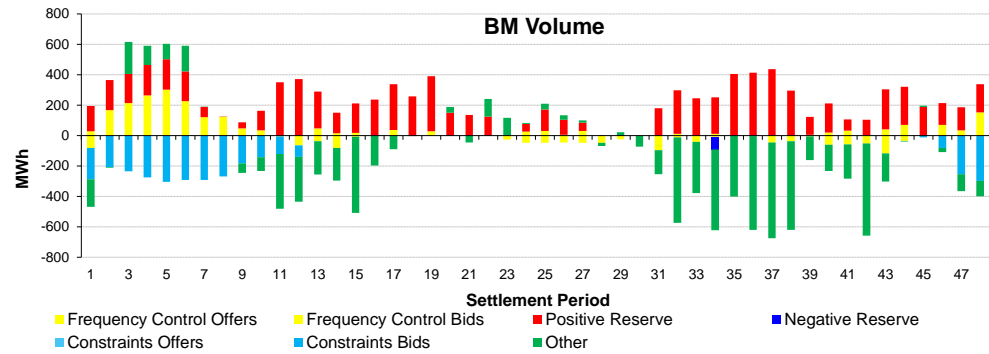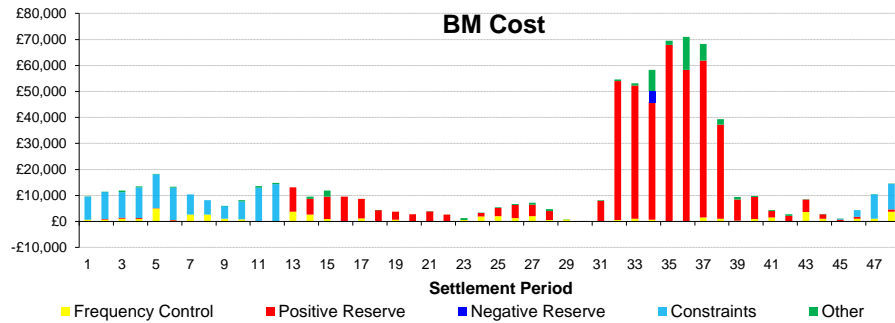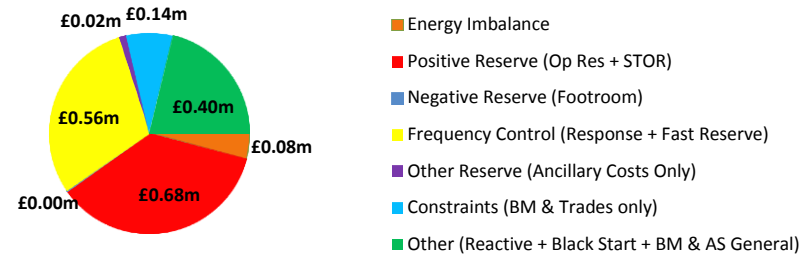

SBP/SSP Vs NIV 01-Nov-2018

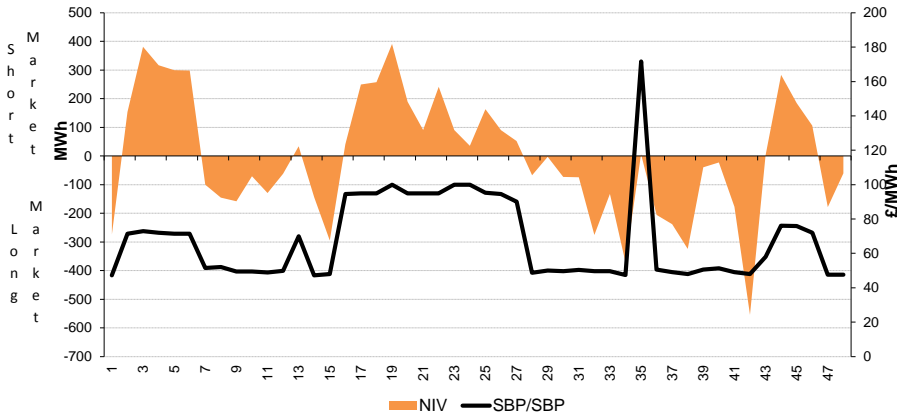

Commentary

Up to 300MW of STOR was run in the morning due to generator and wind shortfall. Generation profile changes and price increases over the darkness peak resulted in actions being taken costing up to £260/MWh to meet margin requirements. ROCOF issues were solved via trades on interconnectors and a BM unit in addition to a small number of BM actions. No system actions were required for voltage control.

Western Link Status: Available