



Date: 26/11/2018

BSUoS Charge Estimate: £1.46/MWh
Total Outturn: £2.15m




Daily Balancing Costs



■ BM Cost (Indicative)
■ AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

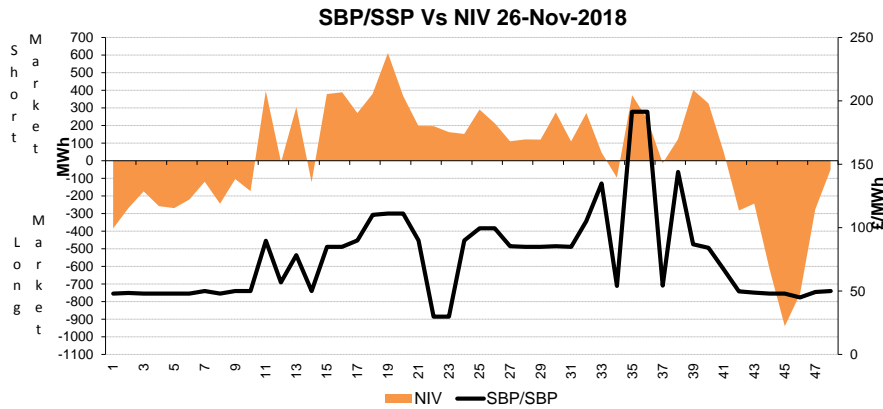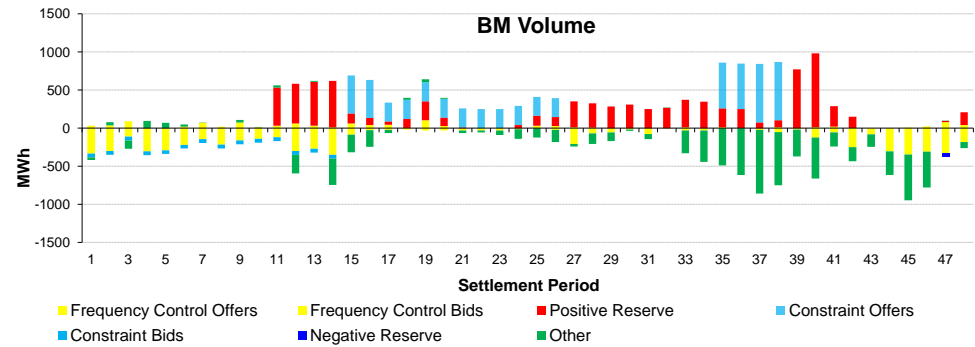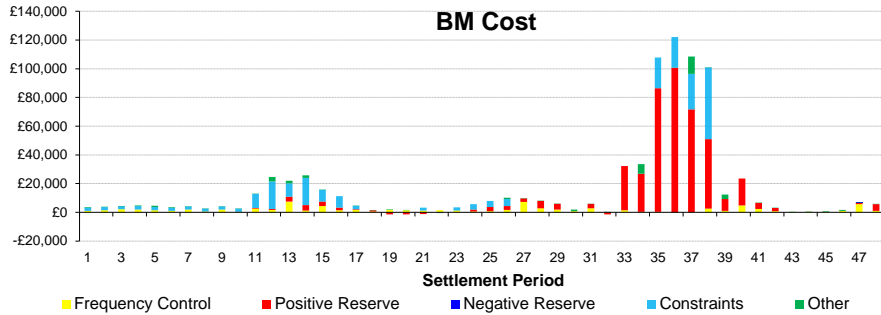

Western Link status: Available

Commentary

During the morning pickup 780MW of STOR was run to cover for plant losses. Trades were carried out on the Interconnectors for positive margin. Overnight trades were required on a BM unit to manage ROCOF. Trades were carried out on the Interconnectors throughout the day to manage South East constraint issues. Plant requirements for voltage management were met by the market