
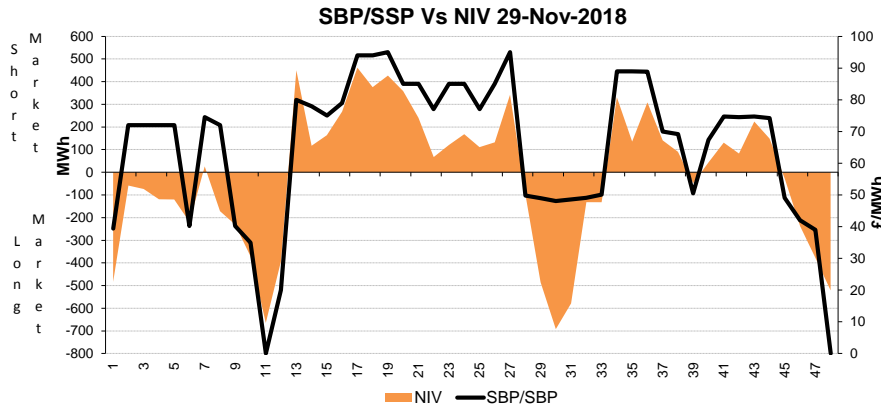
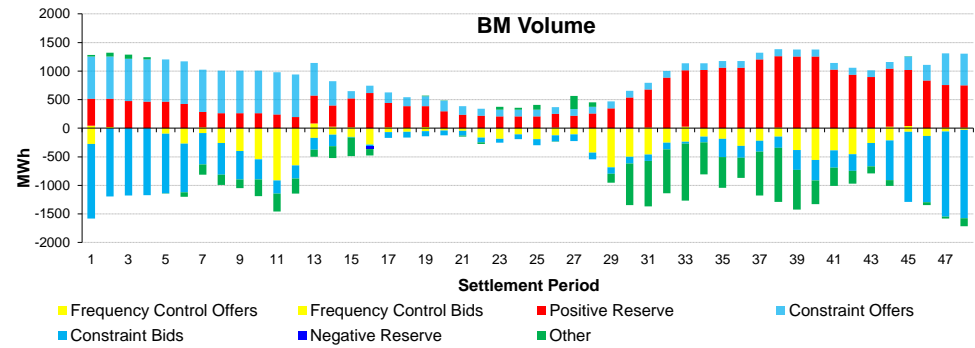
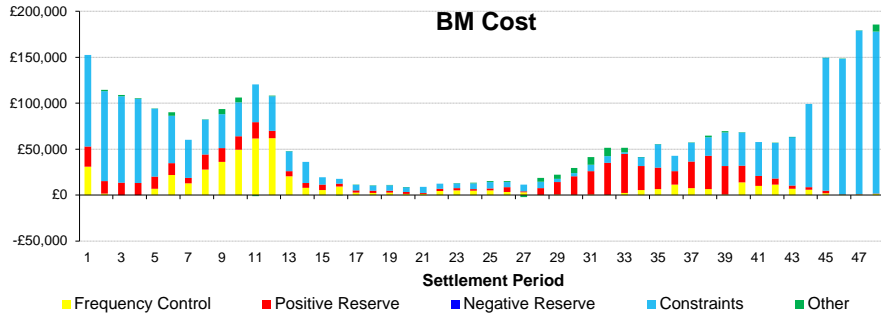
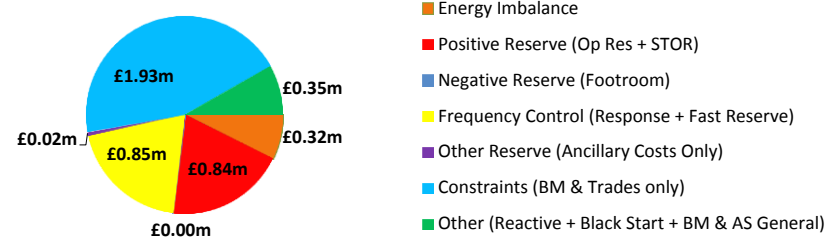


Date: 29/11/2018

BSUoS Charge Estimate: £2.92/MWh
Total Outturn: £4.32m

Daily Balancing Costs

■ BM Cost (Indicative)
■ AS Cost (Estimate)



Western Link status: Available

Commentary

Trades were carried out on the Interconnectors for positive margin over the morning peak and again from late afternoon. Additional dynamic response was held from the afternoon onwards. ROCOF was resolved via BM actions and trades on the Interconnectors and several BM units. Trades and BM actions were required to manage a constraint in the North of Scotland in addition to BM actions on wind and water to manage power flow restrictions on the network boundary between Scotland and England. Trades and BM actions were required overnight to manage voltage support in the Midlands, Lincolnshire, South East, South Wales and Scotland.