
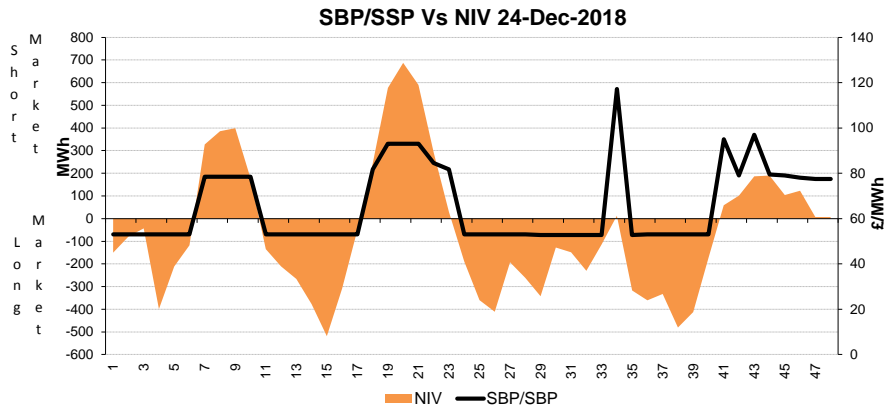
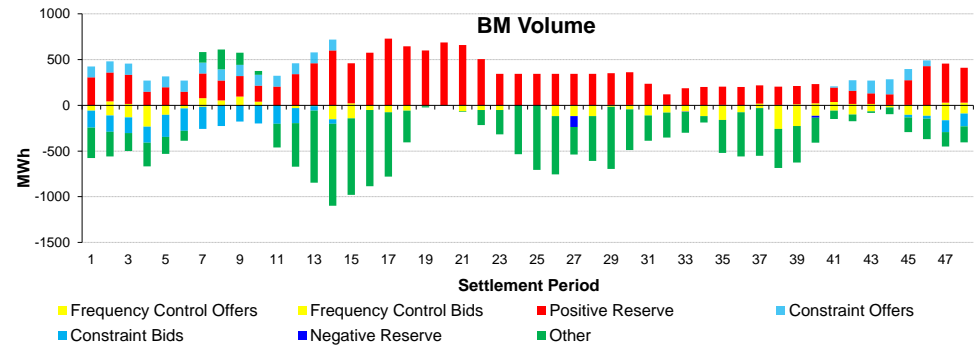
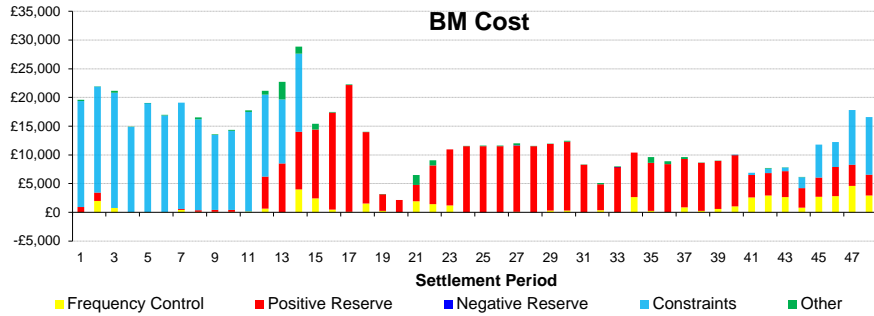
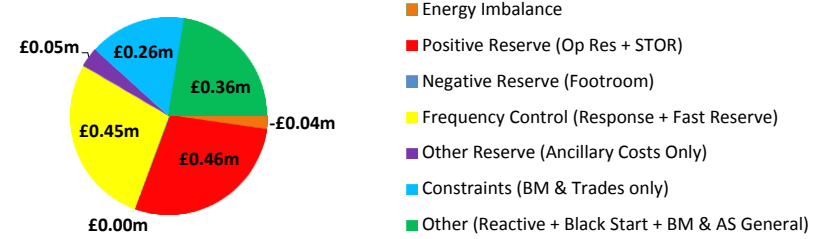


Date: 24/12/2018

BSUoS Charge Estimate: £1.31/MWh
Total Outturn: £1.56m

Daily Balancing Costs

BM Cost (Indicative)
AS Cost (Estimate)



Western Link status: Available

Commentary

The market was mostly long throughout the day, Wind generation was low. Overnight ROCOF was solved with trades on the interconnectors and generating units supported by a small number of BM actions. Trades were also carried out to manage voltage levels in Scotland in the early morning. BM actions were required to resolve a localised constraint in the South of Scotland in the late evening.