
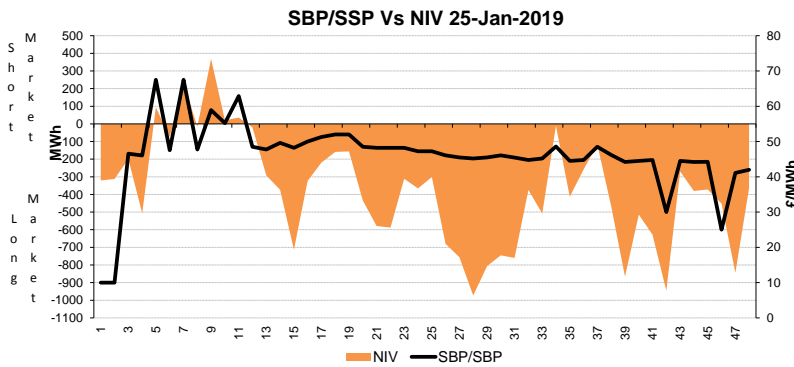
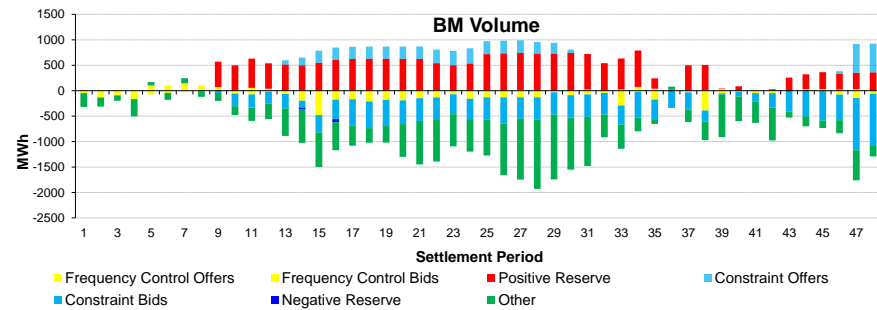
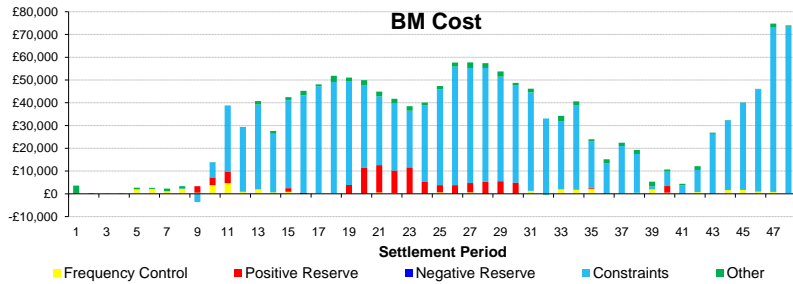
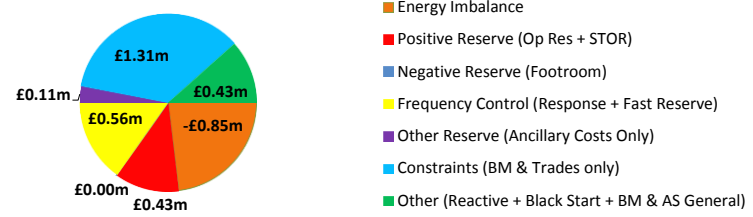


Date: 25/01/2019

BSUoS Charge Estimate: £1.42/MWh
Total Outturn: £1.99m

Daily Balancing Costs

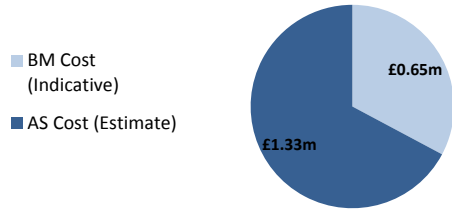

Commentary

System was long through the daytime as wind generation increased sharply. Additional reserve was held through the early part of the day for wind uncertainty. BM actions were required to manage constraints in Scotland, Northern England and the South East. No actions were required for ROCOF or Voltage requirements overnight as all requirements were met by the market.

Western Link status: Available