
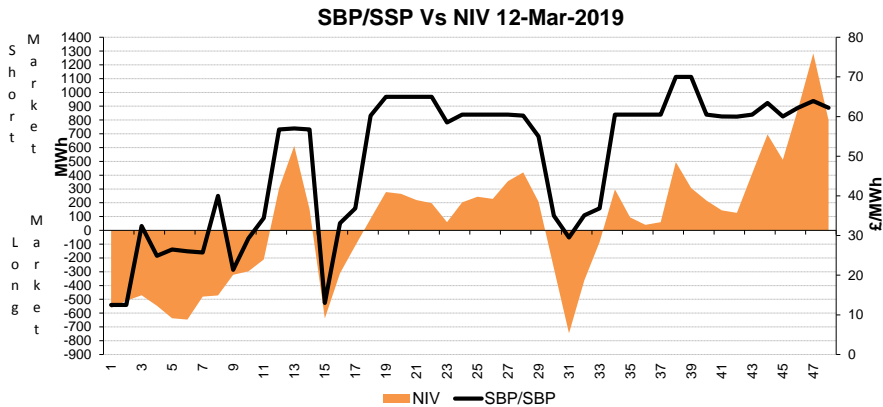
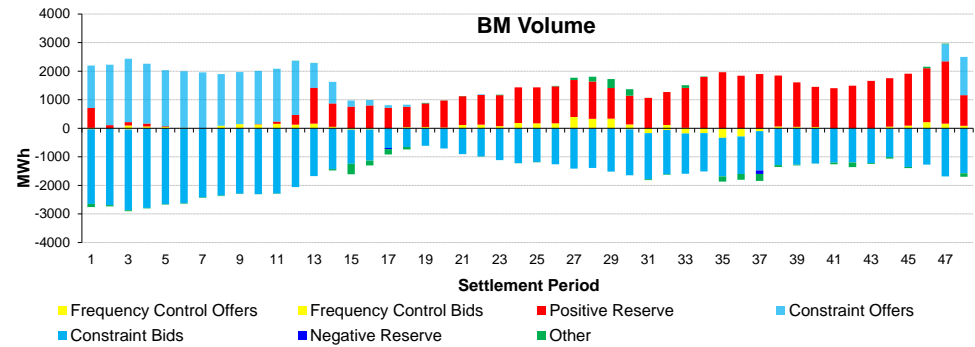
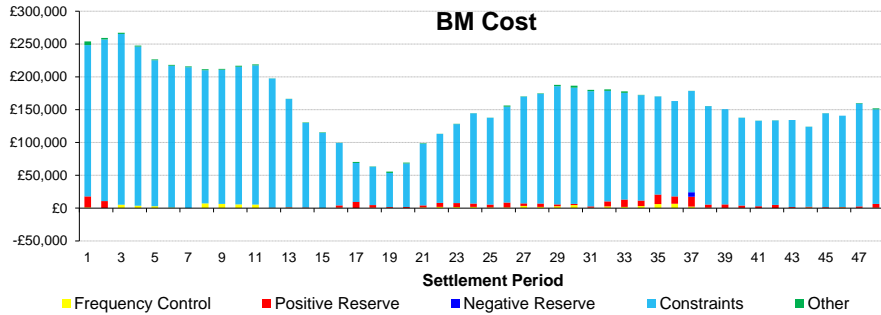
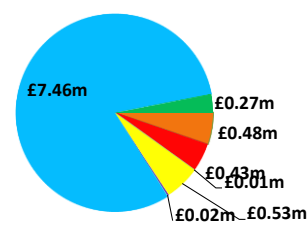


Date: 12/03/2019

BSUoS Charge Estimate: £5.87/MWh
Total Outturn: £9.20m

Daily Balancing Costs

BM Cost (Indicative)
AS Cost (Estimate)



Western Link status: Unavailable

Commentary

System was long overnight before swinging short for the majority of the day time and evening. 415MW of STOR was utilised in the morning and additional response was held in the afternoon and evening for wind volatility. A large amount of trades and BM actions were required overnight to manage ROCOF levels. Trades and BM actions were also required to manage voltage levels in the Midlands, South, South Wales, North and North West. Various power flow restrictions in South Wales, Scotland and on the Scotland England border caused by system outages and high winds were solved through a mixture of trades and BM actions.