






Date: Friday 03 May 2019

BSUoS Charge Estimate: £1.65/MWh
Total Outturn: £1.93m

Daily Balancing Costs



- BM Cost (Indicative)
- AS Cost (Estimate)

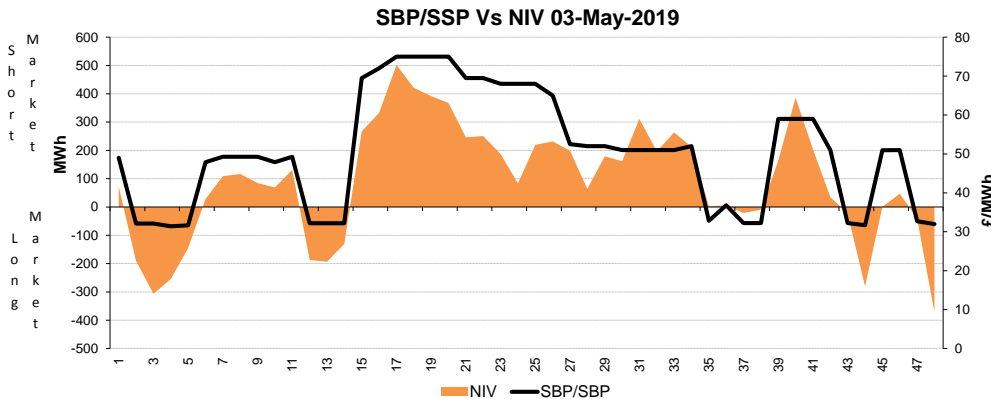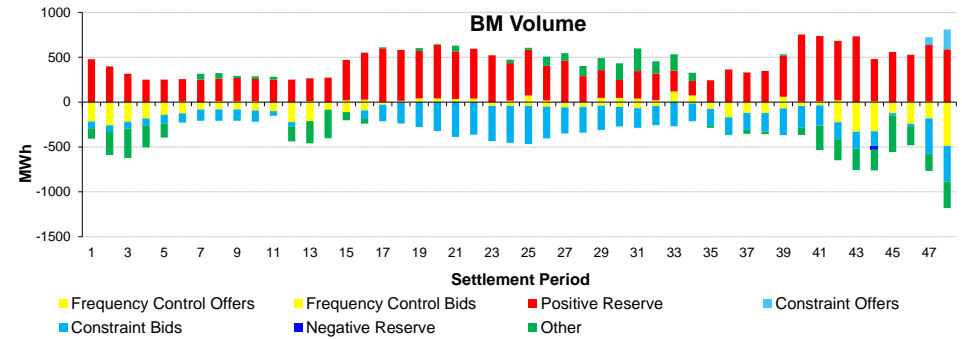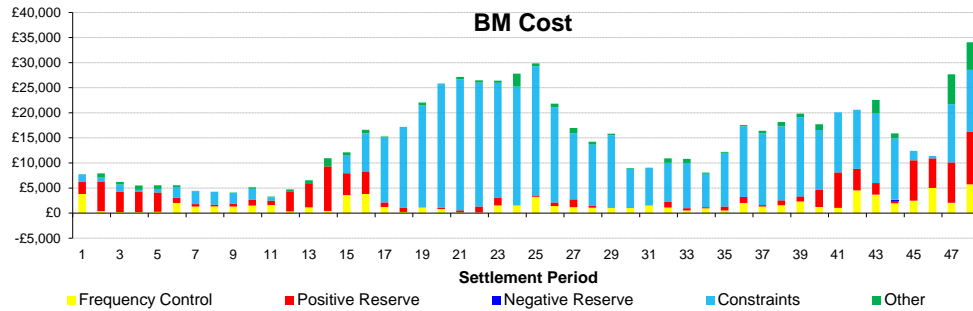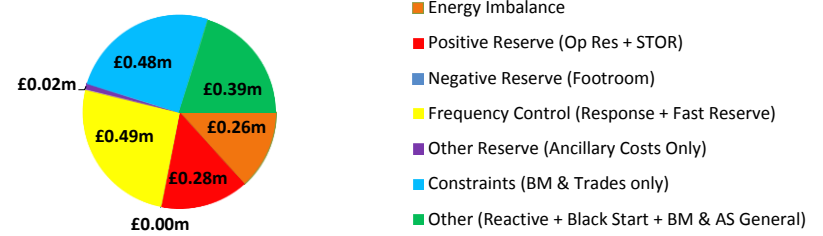

Western Link status: Unavailable

Commentary

The system was fairly tightly balanced throughout the day but did reach 1GW short around the morning pick up. Between 200 and 310MW of STOR was utilised at various points of the day due to plants losses and demand uncertainty. Spin Gen was also utilised due to tight margins and demand uncertainty for the majority of the daytime. Trades on the interconnectors and BMUs were used to manage ROCOF levels overnight. BM actions were taken to manage power flow restrictions in Scotland due to planned outages.