



Date: Saturday 29 Jun 2019

BSUoS Charge Estimate: £3.67/MWh
Total Outturn: £3.76m




Daily Balancing Costs

BM Cost (Indicative)

AS Cost (Estimate)

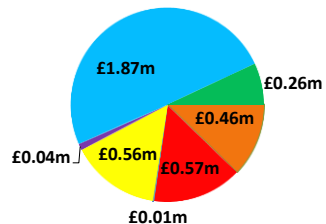

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

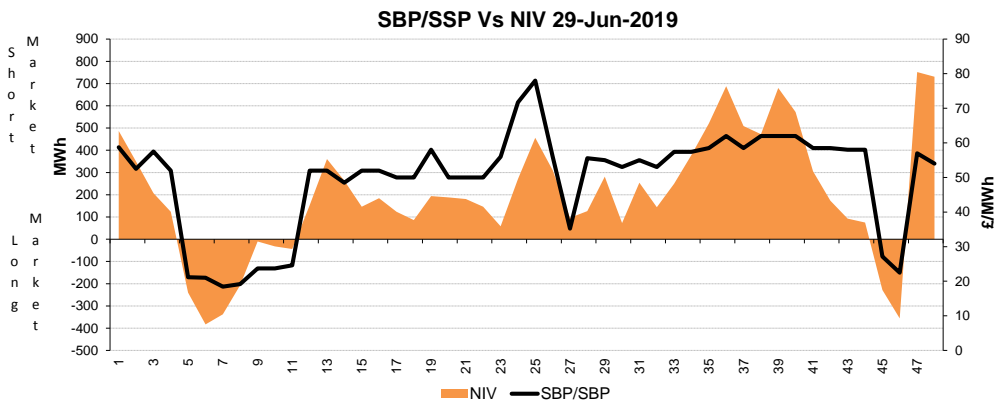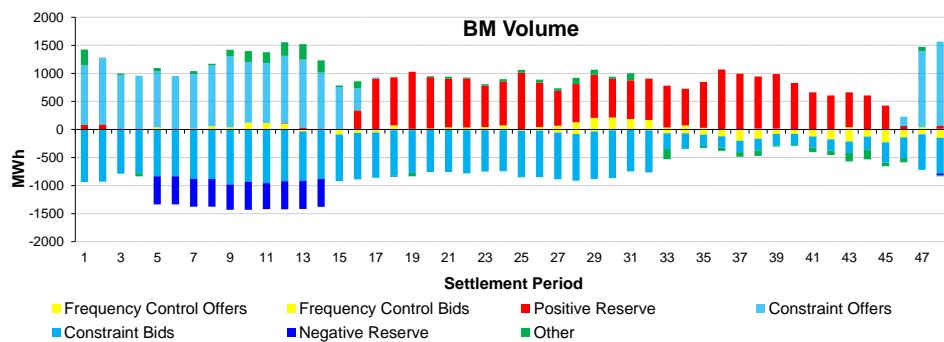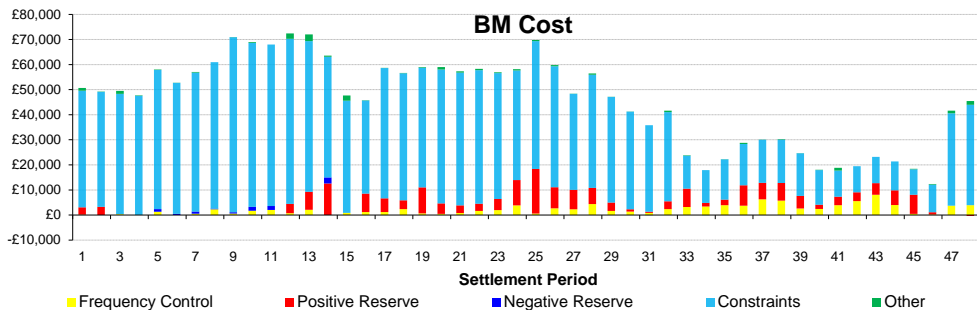

Commentary

Interconnector trades made for Downward margin for the early morning. Between 22:00 and 23:00 spin gen was used as margin was tight. NBM STOR used intermittently throughout the day.

Trades and BM actions taken to resolve System Inertia and Voltage control issues around the south east and midlands area.

Western Link status: Available