
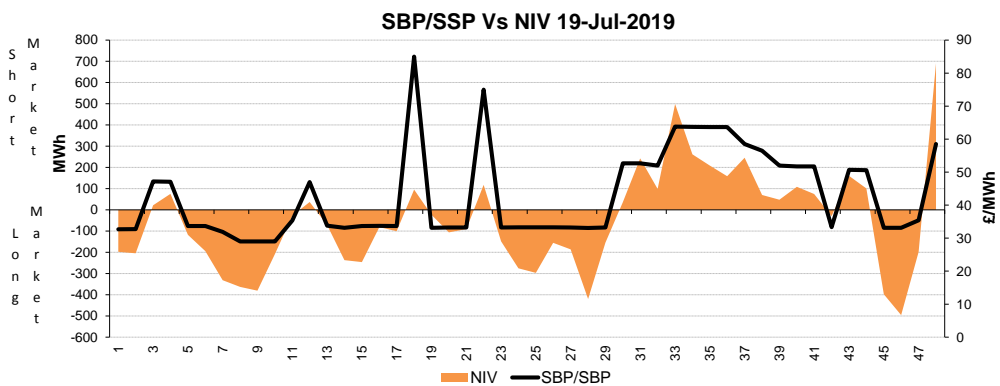
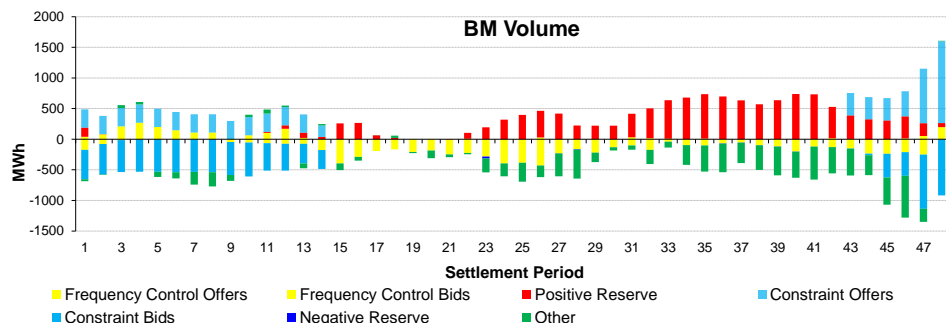
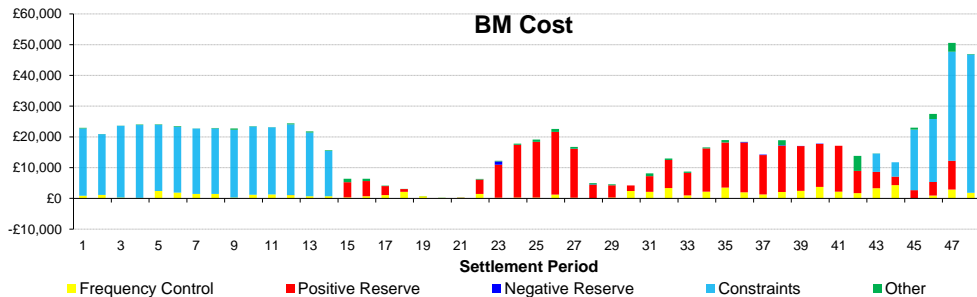
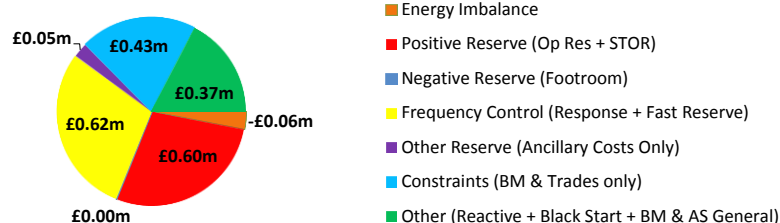


Date: Friday 19 Jul 2019

BSUoS Charge Estimate: £1.88/MWh  
Total Outturn: £2.02m

# Daily Balancing Costs

BM Cost (Indicative)  
AS Cost (Estimate)



## Commentary

The short market peaked at approximately 1400MW at the very end of the day where there was rapid decay in demand. Up to 600MW of STOR was called off to manage the shortfall in wind generation at midday.

Trades were needed to manage system inertia and voltage control in the early morning period of the day. Trades for overnight period was carried out for voltage issues in the south of England. Interconnector trades were placed to manage constraint issues in the south of England during the overnight period.

**Western Link status: Available**