
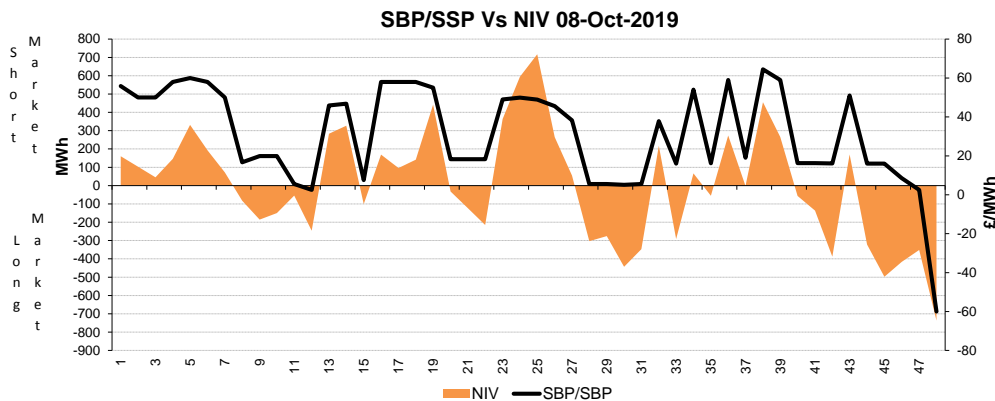
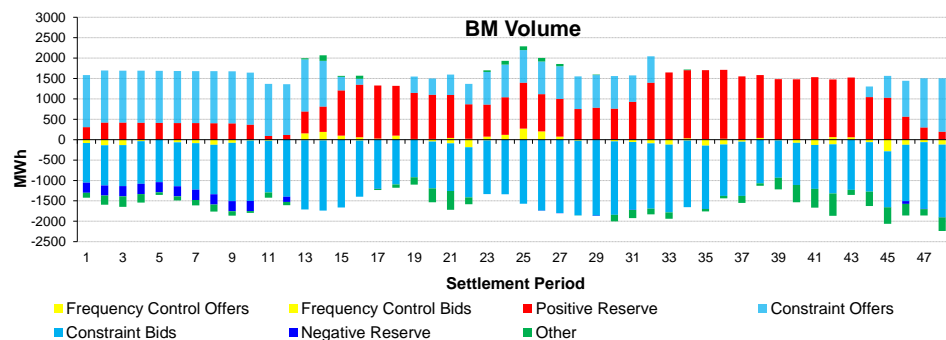
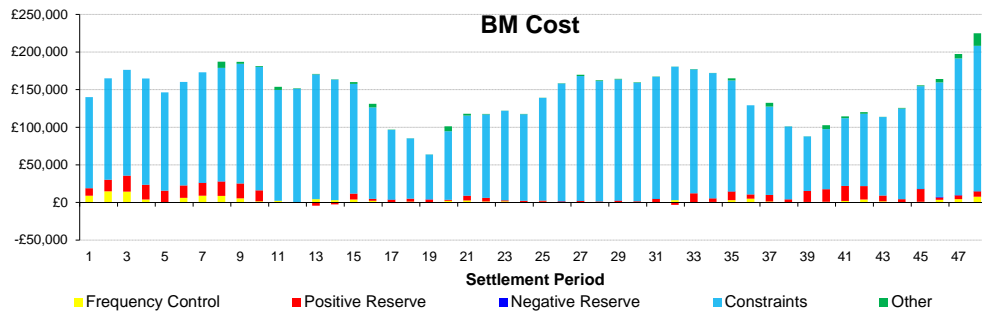
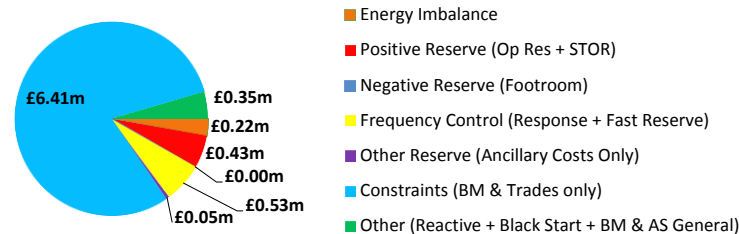


Date: Tuesday 08 Oct 2019

BSUoS Charge Estimate: £6.10/MWh
Total Outturn: £8.00m

Daily Balancing Costs

- BM Cost (Indicative)
- AS Cost (Estimate)



Commentary

The market alternated between short and long. PV was less than forecast. High wind conditions required Trades and BM Actions overnight and throughout the day to manage thermal constraints in Scotland. BM Actions eased power flow constraints in the North and North West, with Interconnector Trades easing thermal import constraints in the South East. Overnight Voltage control managed with Trades and BM Actions. System Inertia supported with BM Actions; Interconnector Trades morning onwards.

Western Link status: Available