
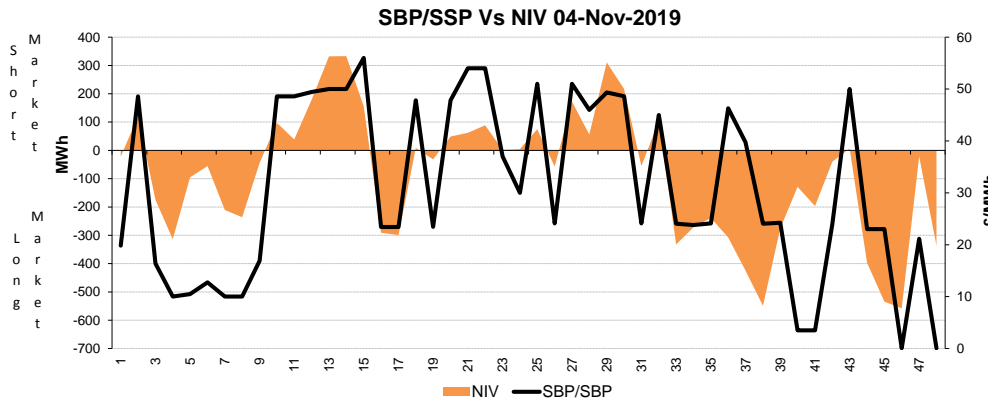
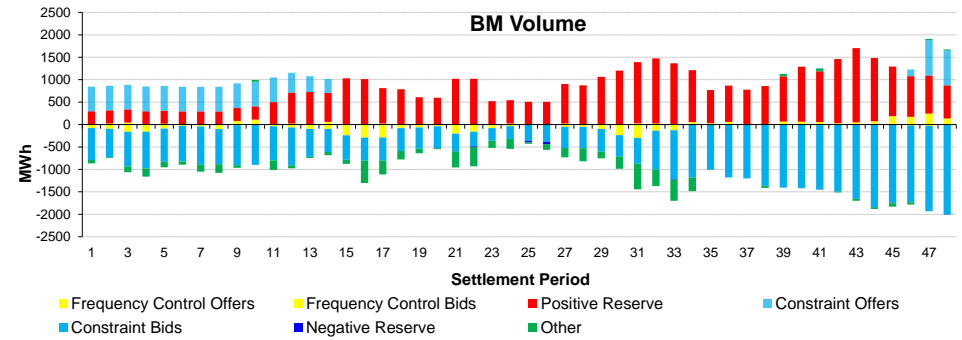
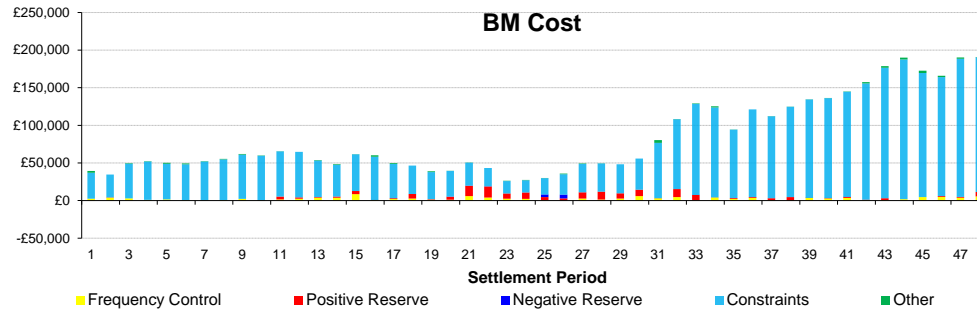
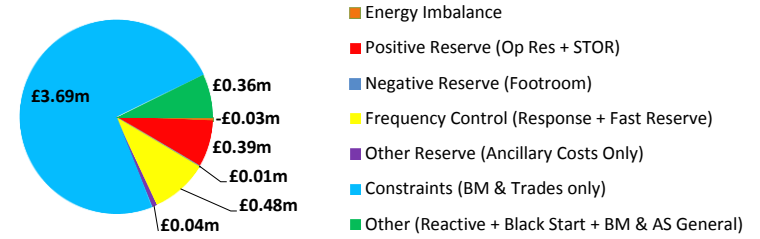


Date: **Monday 04 Nov 2019**

BSUoS Charge Estimate: £3.33/MWh
Total Outturn: £4.93m

Daily Balancing Costs

- BM Cost (Indicative)
- AS Cost (Estimate)



Western Link status: Not Available

Commentary

The market was long overnight and again from late afternoon onwards into the night. It was mostly short from early morning to late afternoon.

There is a current outage on the Western Link Interconnector. In conjunction with this and high winds, BM Actions required to alleviate power flow constraints in Scotland and the North area throughout the day, especially midday onwards into the night. Some overnight Trading was required to assist localised thermal constraints in Scotland.

Overnight Voltage Support was managed with Trading and BM Actions in the South, South East and Midlands areas. Trading and Interconnector Trades mitigated overnight RoCoF risk, with BM Actions supporting.