
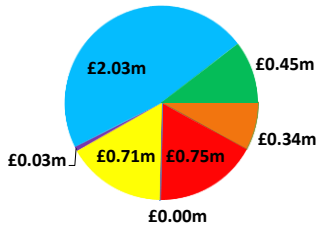


Date: Thursday 28 Nov 2019




BSUoS Charge Estimate: £2.82/MWh
Total Outturn: £4.33m

Daily Balancing Costs

BM Cost (Indicative)
AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

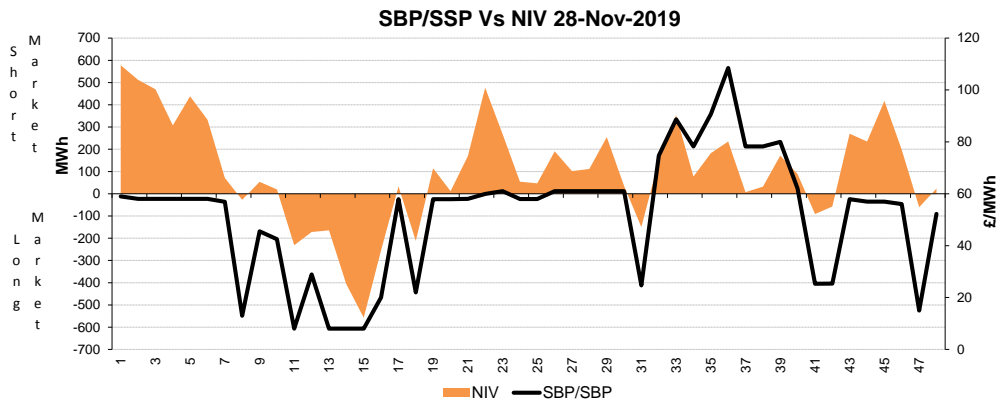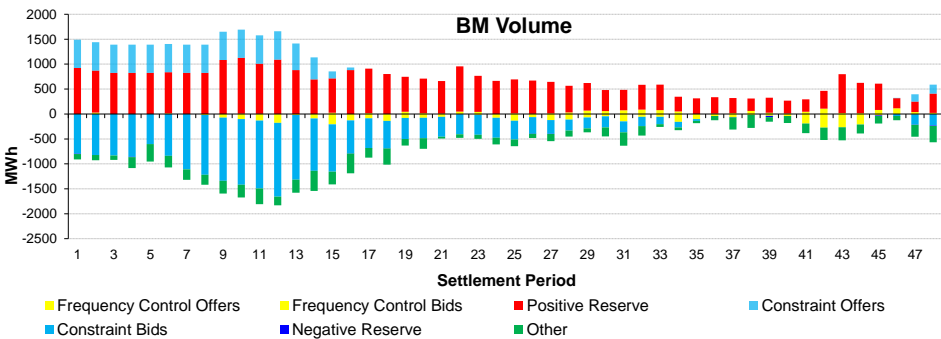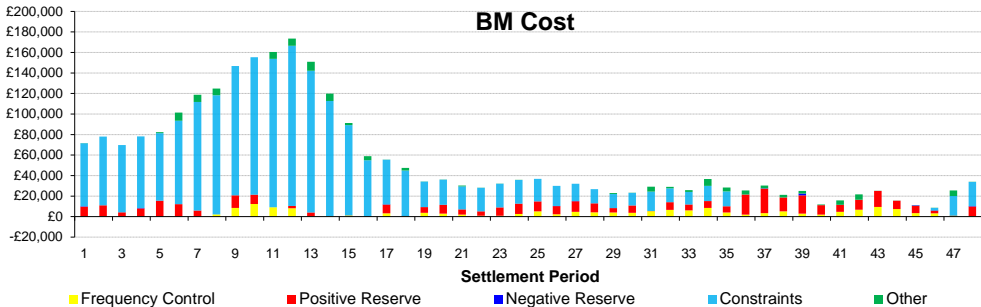

Commentary

There was a mostly long market through the early morning but wind output began to shortfall during the pickup. BM Actions were required through the early morning to reduce thermal constraints in Scotlands. Overnight trades were carried out for RoCoF requirements.

Western Link status: Available