
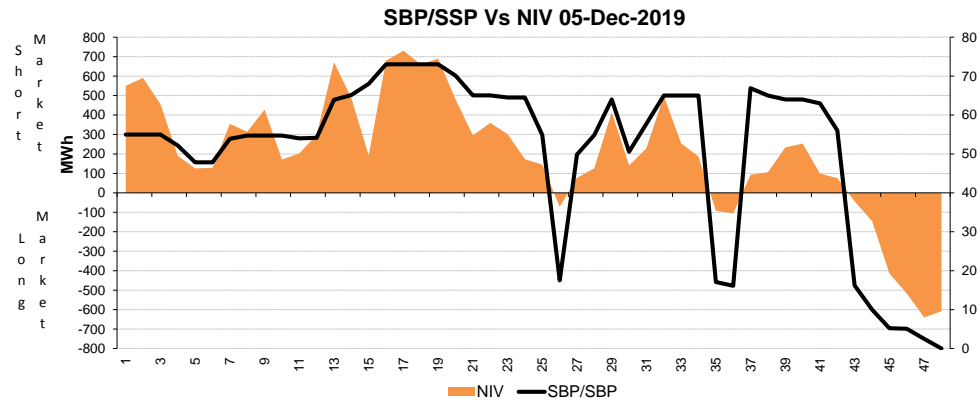
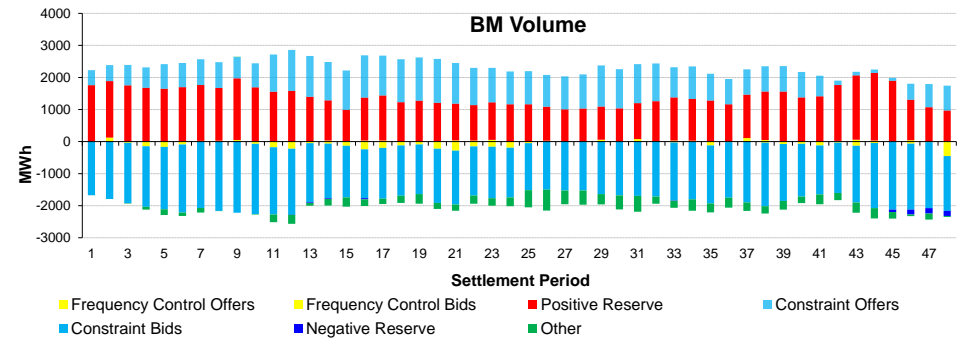
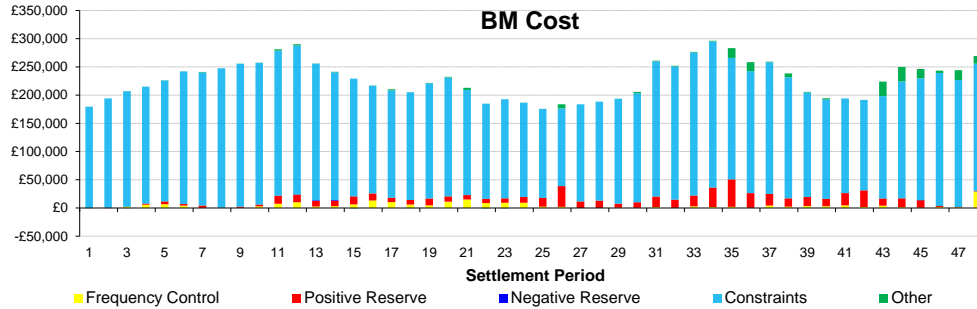
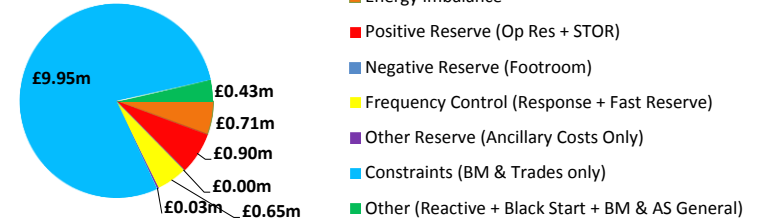


Date: Thursday 05 Dec 2019

BSUoS Charge Estimate: £7.49/MWh  
Total Outturn: £12.70m

# Daily Balancing Costs

- BM Cost (Indicative)
- AS Cost (Estimate)



## Commentary

A short market in excess of 1300MW for most of the day, required other action on conventional generation. A challenging scenario was presented to the SO, throughout the 24 hours, due to extremely high wind levels across the country in excess of 12.5GW and circuit outages, which were causing heavy power flow congestion across and out of Scotland. This was exacerbated by power flow congestion in the South-East corner of England caused by an unusual high export on the interconnectors to Europe. As a consequence, a very large volume of BM actions was required for most of the day to solve power flow restrictions in Scotland, on the England-Scotland boundary and in England. Additionally, BM Actions were also required to manage the voltage levels overnight in England and to mitigate the RoCoF risk.

Western Link status: Available