

# Action Flagging

# Methodology Statement

Effective Date: 15 November ~~01 April~~ 2022

Version Number: 15.0

Published in accordance with Standard Condition C16 of  
National Grid Electricity System Operator Transmission  
Licence

## Version Control

<u>Date</u>	<u>Version No.</u>	<u>Notes</u>
05.11.09	1.0	Initial version
01.04.12	2.0	Addition of reference to Black Start warning flagging
01.04.13	3.0	Revision following annual review
01.01.14	4.0	Revision to incorporate Supplemental Balancing Reserve and Demand Side Balancing Reserve
01.04.14	5.0	Revision to incorporate the ability to make retrospective changes to the system flagging for BOAs as part of the annual review.
05.11.15	6.0	Revisions: to include actions to manage RoCoF and Fault Levels; to include automatic Low Frequency Demand Disconnection actions; to incorporate changes to the treatment of Supplemental Balancing Reserve and Demand Side Balancing Reserve.
05.11.15	7.0	Revision to incorporate treatment of scenario where SBR units have a SEL equal to their MEL
01.04.16	8.0	Revision following annual review
01.04.17	9.0	<b>Revision to remove Demand Side Balancing Reserve</b>
01.04.18	10.0	Revision following annual review
01.04.19	11.0	Revision following annual review
01.04.20	12.0	Revision following annual review
01.04.21	13.0	Revision following annual review

01.04.22	14.0	Revision following annual review
<u>15.11.22</u>	<u>15.0</u>	<u>Revision following additional review for 2022/23 Winter Contingency Services</u>

The System Management Action Flagging Methodology Statement has been developed by National Grid Electricity System Operator Limited (NGESO).

Where NGESO amends the process for flagging balancing services, NGESO will promptly seek to establish a revised Statement incorporating the changes in accordance with paragraphs 8(a) and 8(b) of Standard Condition C16 of the Transmission Licence (the Licence).

In the event that it is necessary to modify this Statement in advance of issuing an updated version of this document, then this will be done by issuing an additional review ~~supplement~~ to this Statement.

The latest version of this document is available, together with the relevant change marked version (if any), electronically from the National Grid ESO Website:

<https://www.nationalgrideso.com/balancing-services/c16-statements-and-consultations>

Alternatively, a copy may be requested from:

Head of Markets Services

National Grid Electricity System Operator

Faraday House

Warwick Technology Park

Gallows Hill

Warwick CV34 6DA

Email: [BalancingServices@nationalgrideso.com](mailto:BalancingServices@nationalgrideso.com)



## **CONTENTS**

### **PART A Introduction**

1. Purpose of document

### **PART B Flagging**

1. Background to SO Flagging
2. The balancing services that will be SO-Flagged
3. Flagging forward trades and Bid-Offer Acceptances

### **PART C Other Issues**

1. Flagging methodology accuracy
2. Failure of Balancing Mechanism System and backup
3. Modifications to the methodology statement

### **PART D Transmission Constraints**

1. Definition of transmission constraint
2. Transmission constraint management process
3. Transmission constraint management description

## **PART A: INTRODUCTION**

### **1. Purpose of document**

The purpose of this Statement is to set out the means which the licensee will use to identify (using reasonable endeavours) balancing services that are for system management reasons.

In the event that it is necessary to modify this Statement in advance of issuing an updated version of this document, this will be done by issuing a supplement to this Statement.

This Statement refers to a number of definitions contained in each of the Grid Code, the Balancing and Settlement Code, and the Licence. In the event that any of the relevant provisions in the Grid Code, the Balancing and Settlement Code or the Licence are amended, it may become necessary for NGESO to modify this Statement so that it remains consistent with the Grid Code, the Balancing and Settlement Code, and the Licence.

In any event, where NGESO's licence or statutory obligations or the provisions of the Grid Code or Balancing and Settlement Code are considered inconsistent with any part of this Statement, then the relevant licence or statutory obligation or code provision will take precedence.

Unless defined in this Statement, terms used herein shall have the same meanings given to them in the Transmission Licence, the Grid Code and/or the Balancing and Settlement Code as the case may be.

## **PART B: Flagging**

### **1. Background to SO-Flagging**

#### Balancing Settlement Code

From the 5<sup>th</sup> November 2009, under Section Q 5.3.1 (d) and Section Q 6.3.2 (b) (iii) of the Balancing and Settlement Code, NGESO is required to determine which balancing services should be classified as SO-Flagged.

To that end, NGESO will determine which balancing services have been taken for system management reasons and will subsequently classify the appropriate services as SO-Flagged.

#### System Management

System Management means:

1. any balancing service used by NGESO that partially or wholly resolves a transmission constraint;
2. any system-to-system balancing service used by NGESO in respect of electricity flows over an interconnector, to avoid adverse effects arising on the National Electricity Transmission System from significant load profile changes;
3. any system-to-system balancing service used by a Transmission System Operator (TSO) other than NGESO, for the purposes of resolving a system operation issue in a connected transmission system;
4. any balancing action used by NGESO primarily to manage the Rate of Change of Frequency (RoCoF) or to manage Fault Levels;
5. any automatic Low Frequency Demand Disconnection relay demand control action.
- 5-6. any balancing action taken by NGESO through the Winter Contingency contracts to manage system security.

## Transmission Constraints

Transmission constraints and the processes NGENSO employs to resolve them are discussed in Part D of this document. However, in summary, transmission constraint occurs when there is a limit on the ability of the national electricity transmission system, or any part of it, to transmit the power supplied onto the national electricity transmission system to the location of demand. Any balancing service taken by NGENSO in order to avoid power flow exceeding a limit will be considered as resolving a transmission constraint.

### **2. The balancing services that will be SO-Flagged**

Balancing services are defined in the Procurement Guidelines which NGENSO is required to establish in accordance with Standard Condition C16 of the licence. The purpose of the Procurement Guidelines is to set out the kind of balancing services which NGENSO may be interested in purchasing, together with the mechanism by which NGENSO envisages purchasing such balancing services.

The following balancing services will be assessed to determine which of them were used for system management reasons, and consequently, should be SO-Flagged:

## Forward Contracts

The following forward-trading actions will be assessed in accordance with the System Management Action Flagging Methodology:

- energy related products; and system-to-system services.



### Bid-Offer Acceptances

All Bid-Offer Acceptances (BOAs) taken within the Balancing Mechanism (BM) including Replacement Reserves Acceptances in relation to Balancing Mechanism Units (BMUs) will be considered, to determine whether they were used for system management reasons.

### Option Contracts

BM Start-Up option contracts used by NGENSO to facilitate access to energy from BMUs that would not have otherwise run and are unable to start up within BM timescales, will be assessed in accordance with the System Management Action Flagging Methodology.

Where NGENSO determines that a BM Start-Up option contract has been taken for the purposes of system management, the associated costs will not be included within the Buy Price Adjuster (BPA) of the Balancing Service Adjustment Data (BSAD).

### Emergency Instructions

In certain circumstances, NGENSO may need to take emergency actions which exceed the bids and offers available to it in the BM in order to maintain the integrity of the transmission network in accordance with BC2.9 of the Grid Code. If such action is taken, NGENSO will analyse the action post event and determine the energy profile of the emergency action. NGENSO will then determine whether these actions are taken for system management reasons. In instances where Emergency Instructions have been used for system management reasons NGENSO will classify the resulting Acceptances as Emergency Flagged. For the avoidance of doubt, there is no difference in the meaning of system management for Emergency Instructions.

### *Emergency Deenergisation Instructions*

Emergency Deenergisation Instructions will always be classified as being for system management reasons and will consequentially always be SO-Flagged. Instructions to de-synchronise and deenergise Generating Unit(s) will be issued by NGENSO in accordance with Section 5.2 of the CUSC.

However, as such energy volumes associated with Emergency Deenergisation Instructions are administered through the CUSC, and not open to the 'pay as bid' approach of the BM, these energy volumes will be provided through BSAD as an unpriced volume.

#### *Automatic Low Frequency Demand Disconnection (LFDD) actions*

Automatic LFDD incidents will always be classified as occurring for system management reasons and as such will always be SO-Flagged. From 5 November 2015, automatic LFDD events will be notified by NGENSO as system warnings and published to the BMRS.

#### System to Generator Operational Intertripping

The System to Generator Operational Intertripping service may, in certain circumstances, result in the automatic tripping of Generating Units(s). The contract details associated with a System to Generator Operational Intertripping scheme are contained in section 4.2A of the CUSC. This is considered to be a system management service and will consequently be SO-Flagged. However, this service is administered through the CUSC and therefore such energy volumes will be provided through BSAD as unpriced volumes.

#### Commercial Intertrips

The commercial intertrip service may, in certain circumstances, result in the automatic tripping of Generating Units(s). The use of such a service will always be for system management reasons and SO-Flagged accordingly. However, the energy volume provided through BSAD will be unpriced as the service is not contracted on a £/MWh basis.

### Commercial Fast De-Load Service

The Commercial Fast De-load service may, in certain circumstances, result in the automatic tripping of Generating Units(s). The use of such a service will always be for system management reasons and SO-Flagged accordingly. However, the energy volume provided through BSAD will be unpriced as the service is not contracted on a £/MWh basis.

### Black Start Warming

BOAs issued to BMUs that are warmed and run to maintain Black Start capability should be SO-Flagged. For the avoidance of doubt, all BM Start-Up instructions including, instructions associated with Black Start warming are accounted for within the Balancing Services Adjustment Data (BSAD) Methodology Statement.

### Winter Contingency Service Contracts

All dispatch action of units under the 2022/23 winter contingency service will be tagged as system actions through BSAD.

## **3. Flagging forward trades and Bid Offer Acceptances**

There is a distinction between how NGESO will flag balancing services taken in the forward market and those taken in the BM.

Individual balancing services actions used outside the BM for system management reasons will be SO-Flagged at inception in accordance with the principles set out above. This includes any system-to-system balancing services. Information on whether or not such balancing services have been SO-Flagged will be contained within the BSAD and submitted in accordance with the BSAD methodology statement.

However, due to the demands of real time power system management, it is not practicable to manage the SO-Flagging of BOAs in the same way. Therefore, in real time, NGENSO will identify BMUs that are being used to manage transmission constraints, and any BOAs taken on those units will be automatically SO-Flagged. For the avoidance of doubt, if the use of the BMU has not been assessed as resolving a transmission constraint, any associated BOA will not be SO-Flagged. Whether such balancing services are SO-Flagged will be contained within the Acceptance Data in accordance with Section Q, Paragraph 5.3 of the Balancing Settlement Code.

## **PART C: Other Issues**

### **1. Flagging methodology accuracy**

NGESO considers the flagging methodology described within this document to be a pragmatic solution that will accurately identify the majority of transmission constraints. However, there may, on occasion, be actions that resolve transmission constraints that are not correctly identified by the System Operator. Conversely there may be instances where NGESO incorrectly identifies an action as resolving a transmission constraint.

Where there has been an incorrect SO-Flag applied to any balancing service taken outside of the BM, NGESO will promptly amend the SO-Flag in accordance with the existing BSAD provisions (section Q, paragraph 6.3 of the Balancing and Settlement Code).

Where there has been an incorrect SO-flag applied to any BOA, NGESO will retrospectively amend the flag, in accordance with BSCP18, whenever:

1. A Data Inquiry Report (DIR) is raised by NGESO's Electricity National Control Centre (ENCC); or
2. A discrepancy is observed during the post-event constraint tagging process and confirmed as being the result of incorrect flagging.

In order to provide continued confidence to the industry, NGESO will report annually, as a minimum, on the accuracy of the flagging methodology.

### **2. Failure of Balancing Mechanism System and backup**

There may, under exceptional circumstances, be occasions when NGESO's ability to flag balancing services it has taken for system management reasons will be reduced.

On occasions when the BM system (main system) is unavailable and NGESO is using its back up system, there may be a reduction in the general level of accuracy of NGESO's SO-Flagging. Any loss of accuracy will be due to the increased burden upon NGESO to maintain the integrity of the transmission

system, resulting from utilising a back up system with less functionality than the main system.

In addition, in the unlikely event that there is a simultaneous failure of the main system and the back up system, NGESO will not be able to engage in SO-Flagging since the loss of both systems would make it impractical to undertake this activity.

### **3. Modifications to the methodology statement**

NGESO will review the System Management Action Flagging Methodology should there be any significant changes to the information systems used, the processes employed by NGESO to manage transmission constraints, or any other change that in NGESO's view will have an impact on the effectiveness of the methodology. NGESO will also review the System Management Action Flagging Methodology should the Authority direct NGESO to do so.

NGESO will seek to revise this Statement in accordance with paragraph 8 of Standard Condition C16 (Procurement and use of balancing services) of the licence should a modification be required.

## **PART D: TRANSMISSION CONSTRAINTS**

### **1. Definition of transmission constraint**

Any balancing service that partially or wholly resolves a transmission constraint will be classified as a system management action and SO-Flagged.

A transmission constraint is defined as: any limit on the ability of the national electricity transmission system, or any part of it, to transmit the power supplied onto the national electricity transmission system to the location where the demand for that power is situated, such limit arising as a result of any one or more of:

- (a) the need not to exceed the thermal rating of any asset forming part of the national electricity transmission system;
- (b) the need to maintain voltages on the national electricity transmission system; and
- (c) the need to maintain the transient and dynamic stability of electrical plant, equipment and systems directly or indirectly connected to the national electricity transmission system.

and used by NGENSO to operate the national electricity transmission system in accordance with the National Electricity Transmission System Security and Quality of Supply Standard referred to in standard condition C17.

### **2. Transmission constraint management process**

NGESO has determined that the System Management Action Flagging Methodology should be incorporated within NGENSO's existing transmission constraint management process. Therefore, the following section briefly outlines the transmission constraint process and highlights when SO-Flagging will occur within it. However, it should be noted that the intention is not to provide a definitive description of the transmission constraint process but rather provide a context for the SO-Flagging process. A detailed description of the transmission constraint process can be found in NGENSO's Balancing Principles Statement.

This process is summarised in Chart A below.

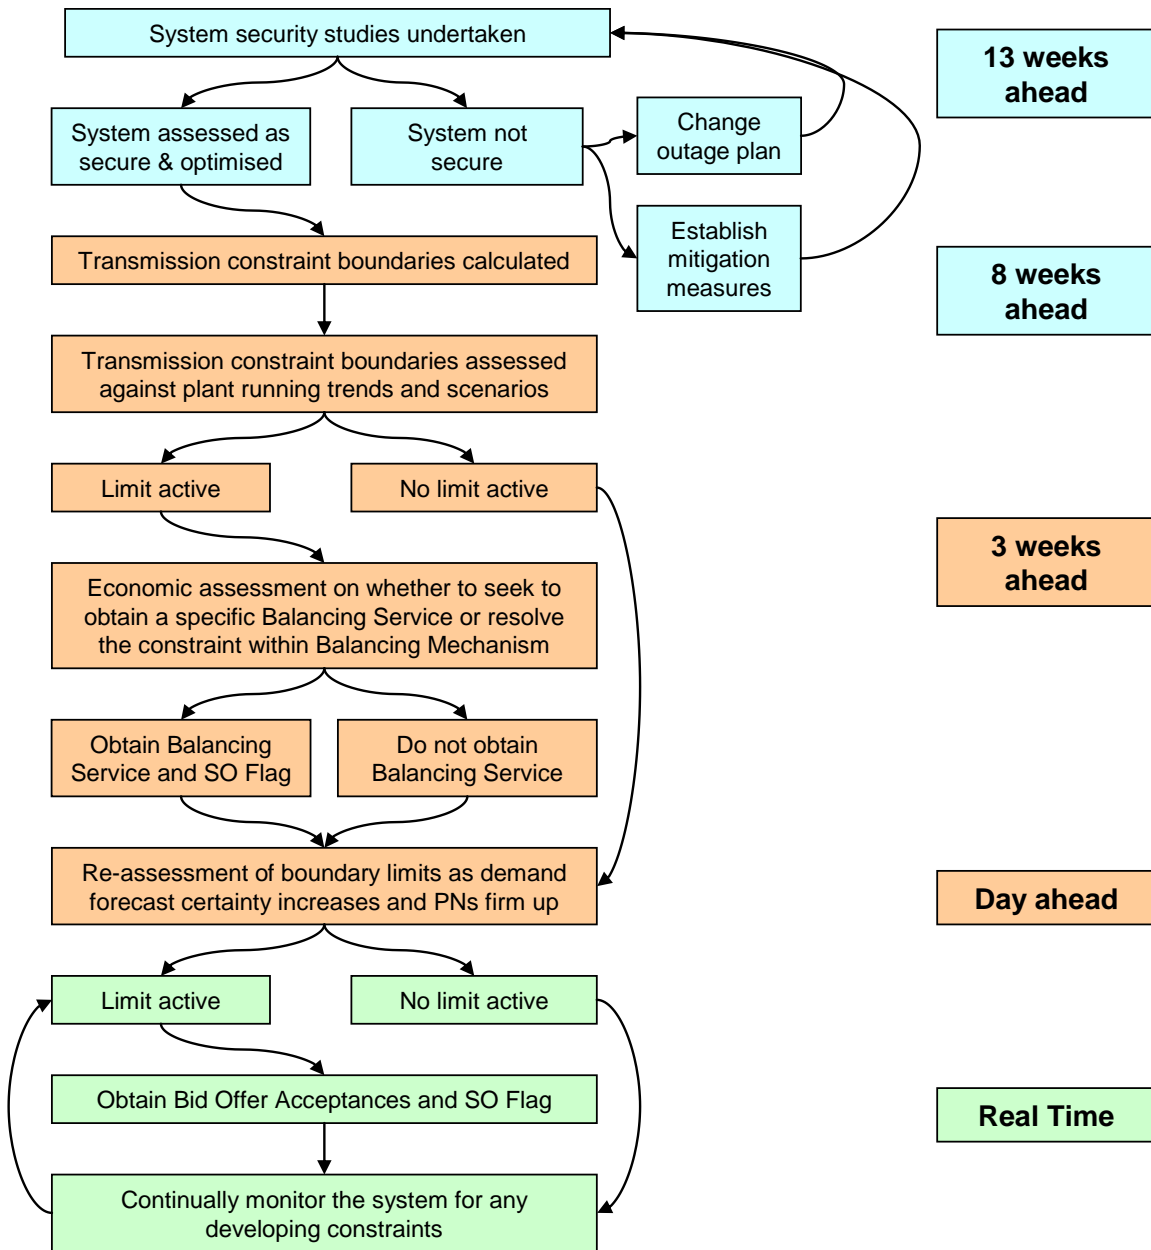


Chart A



### **3. Transmission constraint management description**

The following is a description of the transmission constraint management and flagging process illustrated above.

In “year ahead” timescales, NGENSO seeks to minimise transmission constraints through careful planning of transmission outages. Transmission constraints are calculated and optimised as necessary from thirteen (13) weeks ahead, down to day ahead timescales and in pre Gate Closure control phase, with the objective of ensuring system security at the minimum cost while meeting NGENSO’s system maintenance and construction requirements:

- Step 1        Using NGENSO’s forecast of demand, BMU availability/running, BMU prices and the transmission outage plan, system security analysis studies are undertaken. These studies involve the use of system analysis models that can determine system voltage, thermal, and stability conditions.
  
- Step 2        From these studies, system security is assessed. If security can not be achieved, the outage plan will be reviewed and revised accordingly.
  
- Step 3        Transmission constraint boundaries will be identified and further studies will be undertaken to calculate the limits of the acceptable power flows across the boundaries in accordance with the GB Security and Quality of Supply Standard.
  
- Step 4        At the day ahead stage, following receipt of the initial Physical Notification data, an economic assessment on whether to obtain a specific balancing service in the forward market, or in the BM is undertaken to deal with any forecast transmission constraints. If it is economic and efficient to obtain such a service in the forward market, the balancing service will be SO-Flagged when it is purchased.

### Control Phase – Pre Gate Closure

- Step 5 NGESO will undertake further security analysis studies as it gains greater certainty as to likely system conditions, through demand forecasts and generator Physical Notifications.
- Step 6 The outcome of these studies could result in NGESO making further use of balancing services, through BM Start-Up. Whether this is appropriate will depend upon the options available to NGESO to resolve the constraint and the most economically efficient choice. In the event that a balancing service is used, the action will be identified as SO-Flagged at the point of purchase.

### Control Phase – Real Time

- Step 7 System security is continually monitored in real time through the use of on-line system security analysis studies based on actual system conditions.
- Step 8 BMUs offering BOAs that could be purchased should a transmission constraint materialise in real time are identified. NGESO will flag the relevant BMUs.
- Step 10 Any BOAs subsequently purchased on the flagged BMUs will automatically be identified as SO-Flagged.