
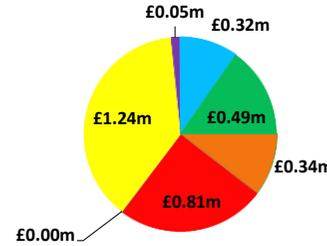


Date: **Monday 23 Aug 2021**




**BSUoS Charge Estimate: £4.05/MWh**  
**Total Outturn: £4.25m**

# Daily Balancing Costs

- BM Cost (Indicative)
- AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

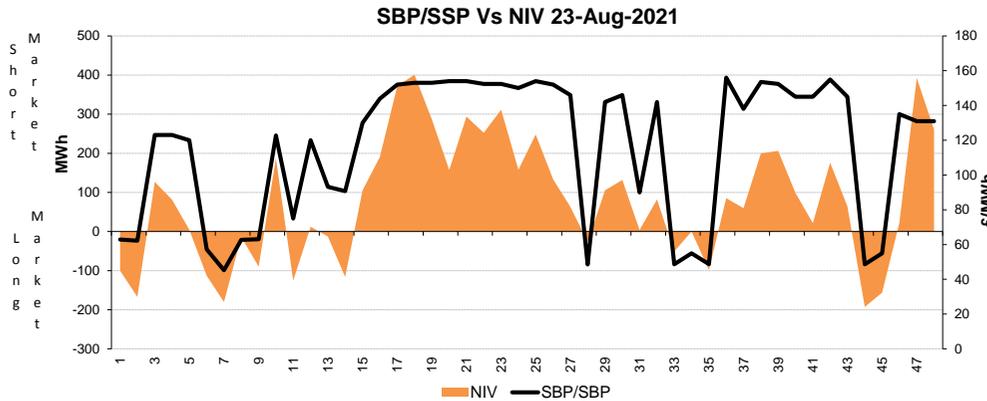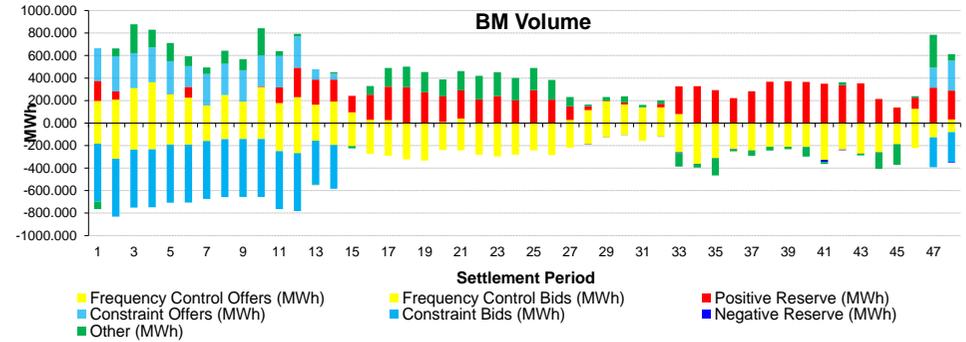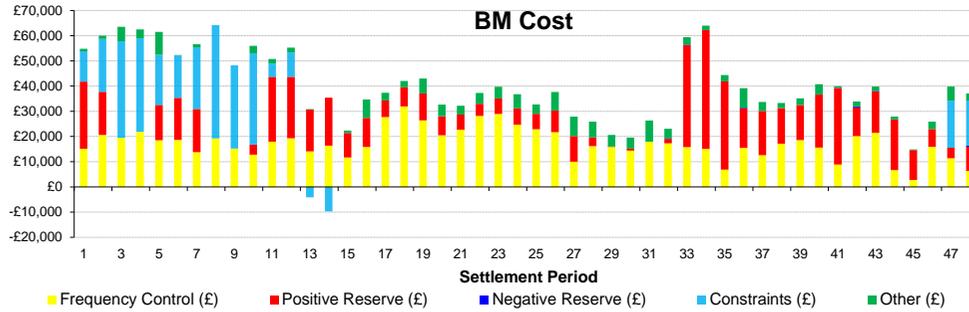

## Commentary

A mostly short market from 7am onwards. 300MW of Non-BM Fast Reserve was run around 7am, and 200MW by late morning. Another 140MW of Non-BM Fast Reserve was required over the late afternoon. Overnight Trades and BM Action for Voltage Control in the Midlands and Greater London areas. Interconnector Trades overnight for RoCoF.