

Date:

Monday 19 Aug 2024

BSUoS Final Tariff: £7.63/MWh



Total Outturn: £10.03m

Daily Balancing Costs






BM Cost (Indicative)

AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

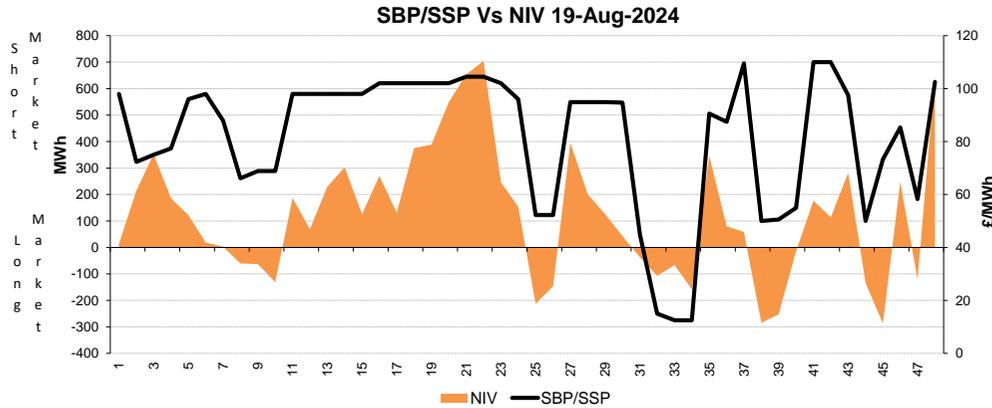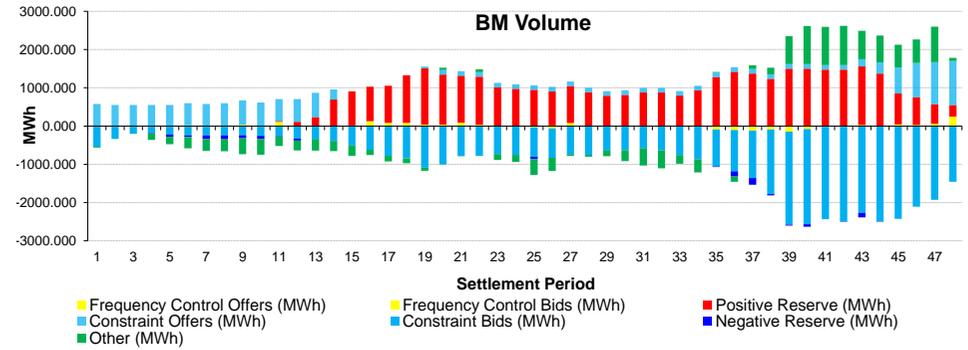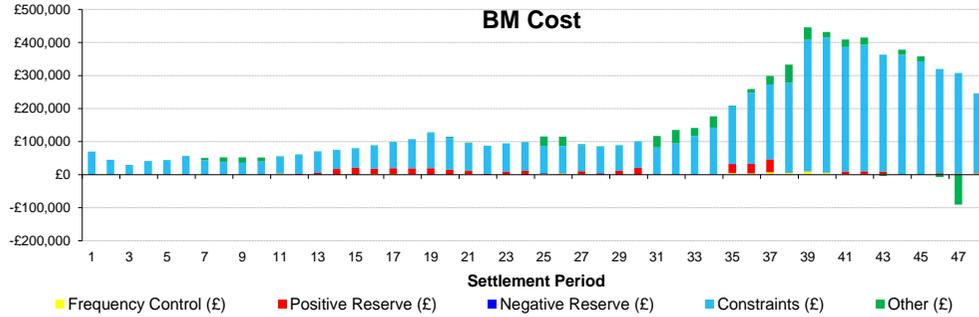

Commentary

The market was alternating between long and short throughout the day. Trades were required for Margin and Downward Regulation. Trades and BM Actions helped manage thermal constraints in both Scotland and England throughout the day. Trades and BM Actions supported Voltage Control. Further BM Actions helped manage System Inertia.