



Date: Tuesday 13 Aug 2024

BSUoS Final Tariff: £7.63/MWh  
Total Outturn: £10.10m




# Daily Balancing Costs



BM Cost (Indicative)  
AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

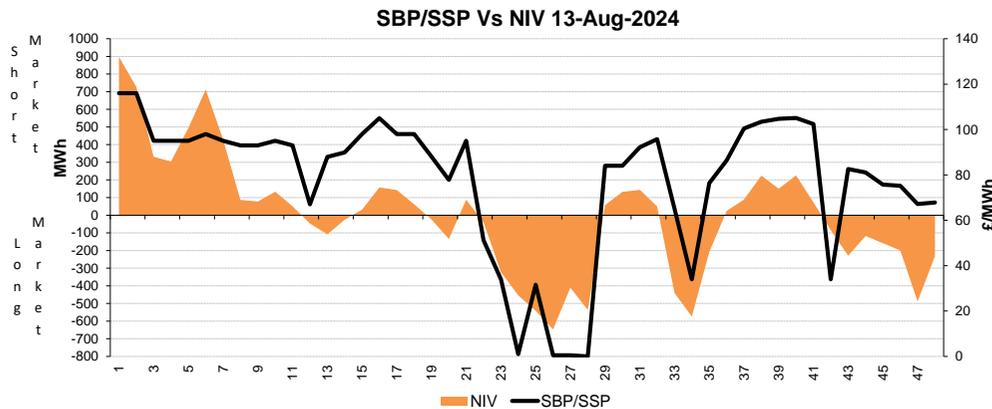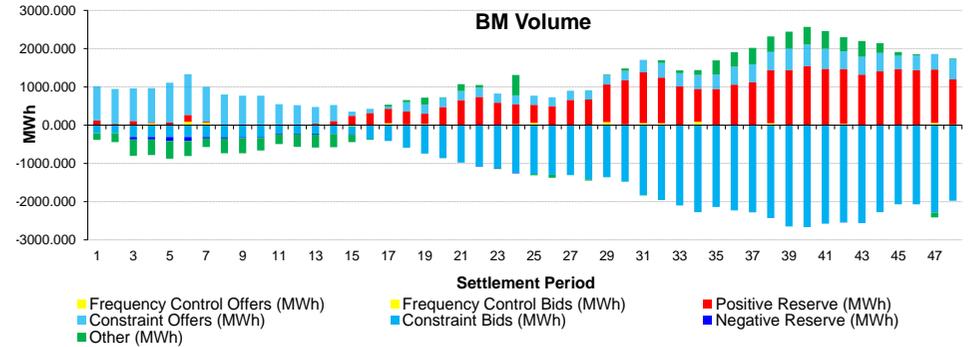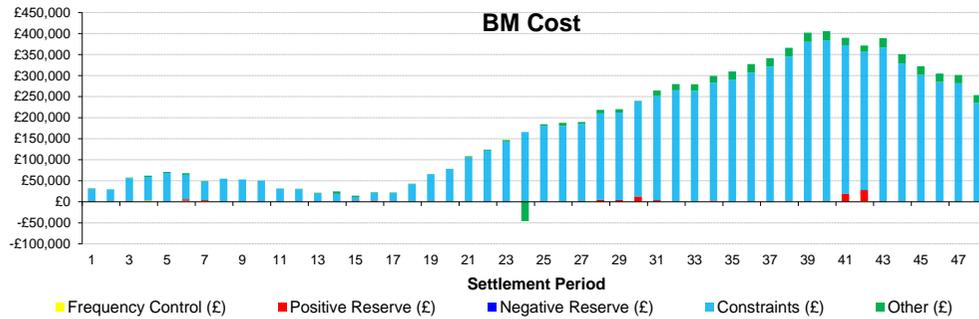

## Commentary

The market was alternating between long and short throughout the day. Trades were required for Margin and Downward Regulation. Trades and BM Actions were required to manage thermal constraints throughout the day. Further BM Actions supported Voltage Control as well as System Inertia.