



Date: Wednesday 28 Aug 2024

BSUoS Final Tariff: £7.63/MWh
Total Outturn: £8.28m




Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)

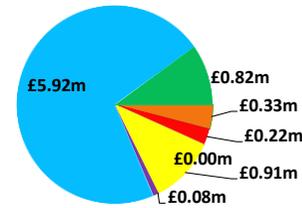

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

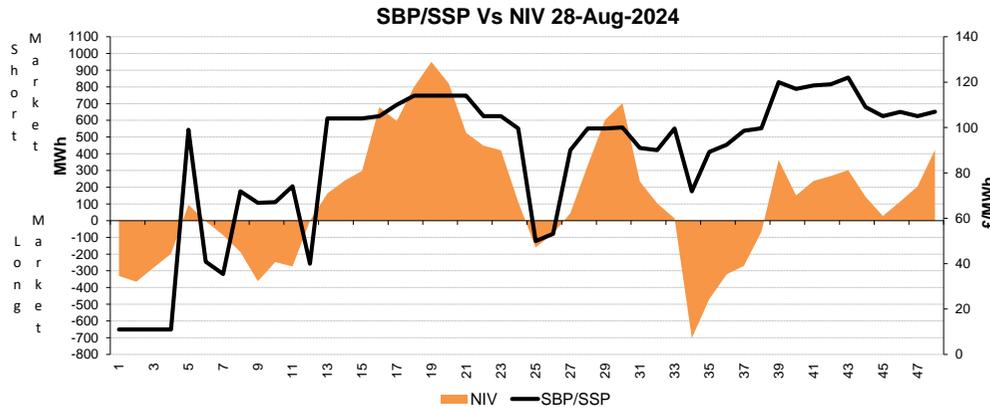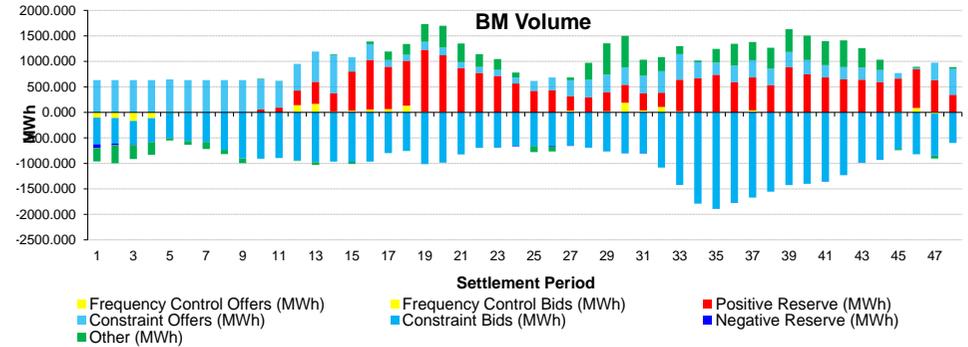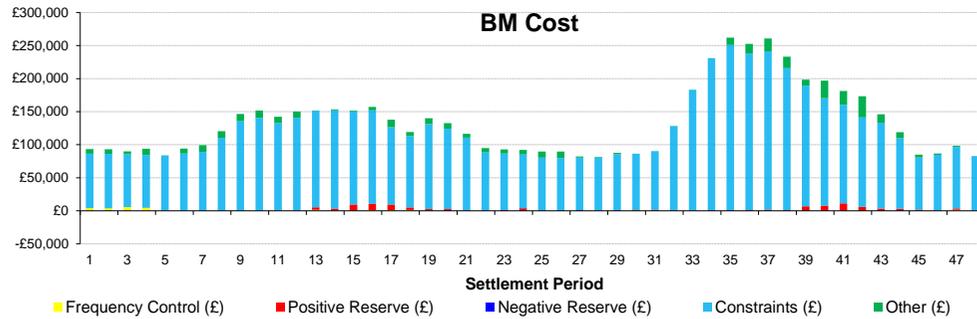

Commentary

The market was alternating between long and short throughout the day. Trades were required for Margin. Trades and BM Actions were required to manage thermal constraints across England, Scotland and Wales throughout the day. Trades and BM Actions supported Voltage Control. Further BM Actions helped to manage System Inertia.