

Date:

Sunday 04 Aug 2024

BSUoS Final Tariff: £7.63/MWh





Total Outturn: £6.61m

Daily Balancing Costs




BM Cost (Indicative)

AS Cost (Estimate)

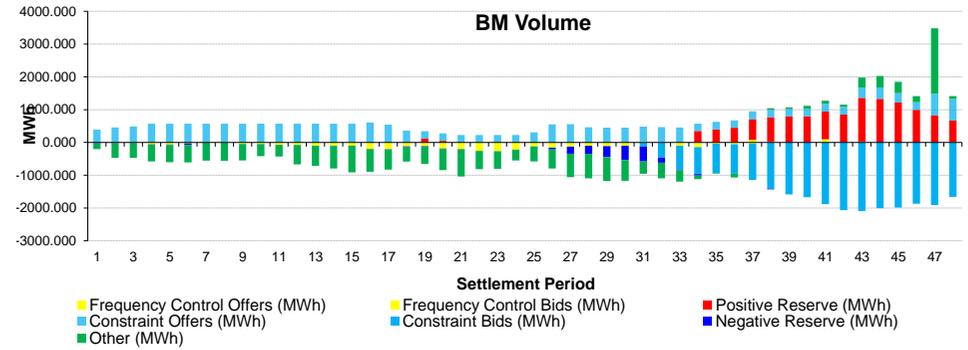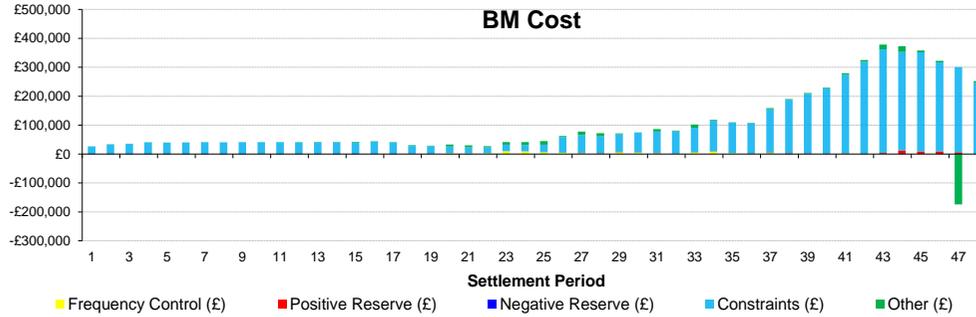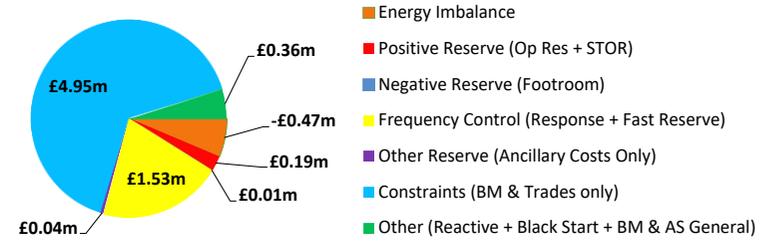

SBP/SSP Vs NIV 04-Aug-2024

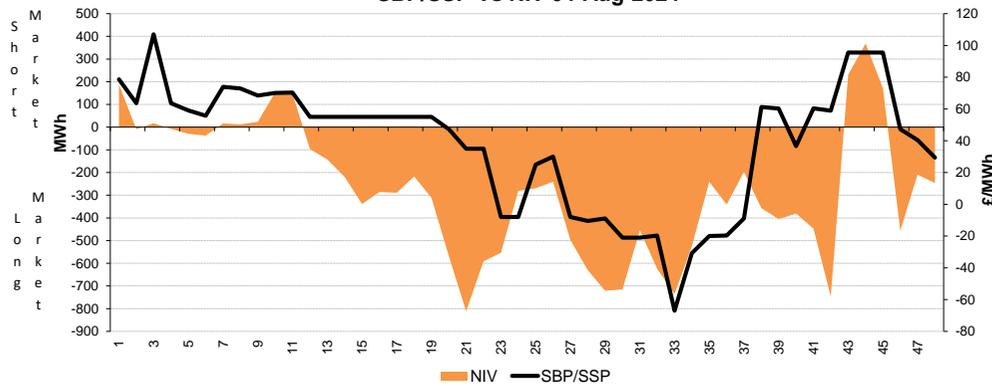

Commentary

The market alternated between long and short throughout the day, though was predominantly long during the daytime from 05:30-21:00. Trades were required for Downward Regulation. Trades and BM Actions helped manage thermal constraints in Scotland and England throughout the day from afternoon. Trades and BM Actions supported Voltage Control. Further BM Actions supported System Inertia.